

Drainage and Wastewater Management Plan

Fowey-Looe-Seaton

May 2023



Table of Contents

Overview	4
Current Performance	9
Environmental Performance.....	15
Future challenges in the catchment	22
Catchment Strategy	24
Medium and Long-Term Plans	31
APPENDICES	72

Status and update information

Version SWW_DWMP_2021/22_0_2023-05-31

This document provides asset, characteristic and performance data for Strategic Planning Areas (Level 2 catchments). Performance data for the time frame up to April 2023 has been utilised to populate these documents.

Production Statement

These documents are produced using an automated process. The process uses a mixture of standard data holdings such as records of assets within the Fowey-Looe-Seaton catchment and documents that are produced as part of modelling and analysis undertaken as part of the DWMP. The decision has been made to leave in tables and figures even if no performance or asset data exists for the catchment to serve as confirmation that no records are held for that particular item.

Data Statement

This document contains asset, characteristic and performance data for Strategic Planning Areas (Level 2 catchments) and has been prepared by South West Water Limited for the purposes of providing area specific detail on assets, risks and proposed interventions for our drainage and wastewater plans. Data records shown in the document for various performance and other metrics may not completely align with Regulatory reported data. This is partly due to the catchment based summation of some data and minor differences in time frames over which DWMP data has been collated compared to the Regulatory reporting time frames.

Contact details

If you have any queries or questions, you can email dwmp@southwestwater.co.uk.

South West Water, Peninsula House, Rydon Lane, Exeter, EX2 7HR

www.southwestwater.co.uk

Overview

Area Details

The Fowey-Looe-Seaton catchment sits within the administrative district of Cornwall. It covers the main settlements of Looe, Liskeard, Fowey, Lostwithiel, Polperro, Dobwalls, Tremar, Dowlunderry, Pelynt, St Cleer, Bodmin, Seaton, Lerryn, Polruan, Duloe, Menheniot, St Neot, Lanreath, East Taphouse, Doublebois, Mount, Golant, Darite, St Keyne, Widegates, Carey Park, Minions, Moorswater, Higher Tremarcoombe and Rosecraddoc.

The population of the Fowey-Looe-Seaton catchment in 2020 was 30,167 and is projected to grow to 34,315 by 2050, an increase of 13.8 %. The catchment is also impacted by the influx of tourists during the summer, with an increase of 8,851 or 29.3 % over the existing resident population.

The Fowey-Looe-Seaton catchment contains 22 km of watercourses including 13 km of Main River as designated by the Environment Agency (EA). This includes the Cardinham Water, East Looe River, River Fowey, River Lerryn, River Loveny, River Seaton, Treliddon Lake and West Looe River.

Discharges in the Fowey-Looe-Seaton catchment may impact on the bathing waters of East Looe Beach, Millendreath Beach, Readymoney Cove and Seaton Beach (Cornwall) and the shellfish waters of Fowey.

Details about local geology and soil structure can be found on the [British Geological Survey](#) website.

Wastewater Network

The Fowey-Looe-Seaton catchment area has approximately 232km of mapped sewers and 14 sewage pumping stations (SPS) to convey wastewater away from homes and businesses to 27 Sewage Treatment Works. It has both separate (foul or surface water) and combined (foul and surface water) networks.

During severe rainfall events, where sewers convey foul and storm water, sewer capacity can be exceeded and to prevent flooding of homes and businesses, storm overflows act as built-in pressure relief valves and allow flows above a certain level to be discharged to rivers and seas. Storm overflows are permitted by the EA.

There are 50 overflows of which 5 are emergency overflows in the Fowey-Looe-Seaton catchment (which should only operate as a result of other asset failure or power loss). There are 50 Event Duration Monitors (EDM's) installed to monitor spill frequency and spill duration.

A summary of the mapped wastewater network lengths is included in Table 1 below:

Table 1: Wastewater network lengths by system type

Sewer Type	Length (km)
Combined	173.8
Surface	26.1
Foul	32.1

Area Overview

Table 2 summarises the number of critical assets within the Fowey-Looe-Seaton catchment and a count of intersections with shellfisheries and bathing waters. The Level 3 (treatment works) catchments and neighbouring areas are shown in Figure 1.

Table 2: Count of key catchment environments/assets

Shellfisheries	Bathing Waters	SPS	Storm Overflows	Emergency Overflows	Monitored Storm Overflows
1	4	14	45	5	50

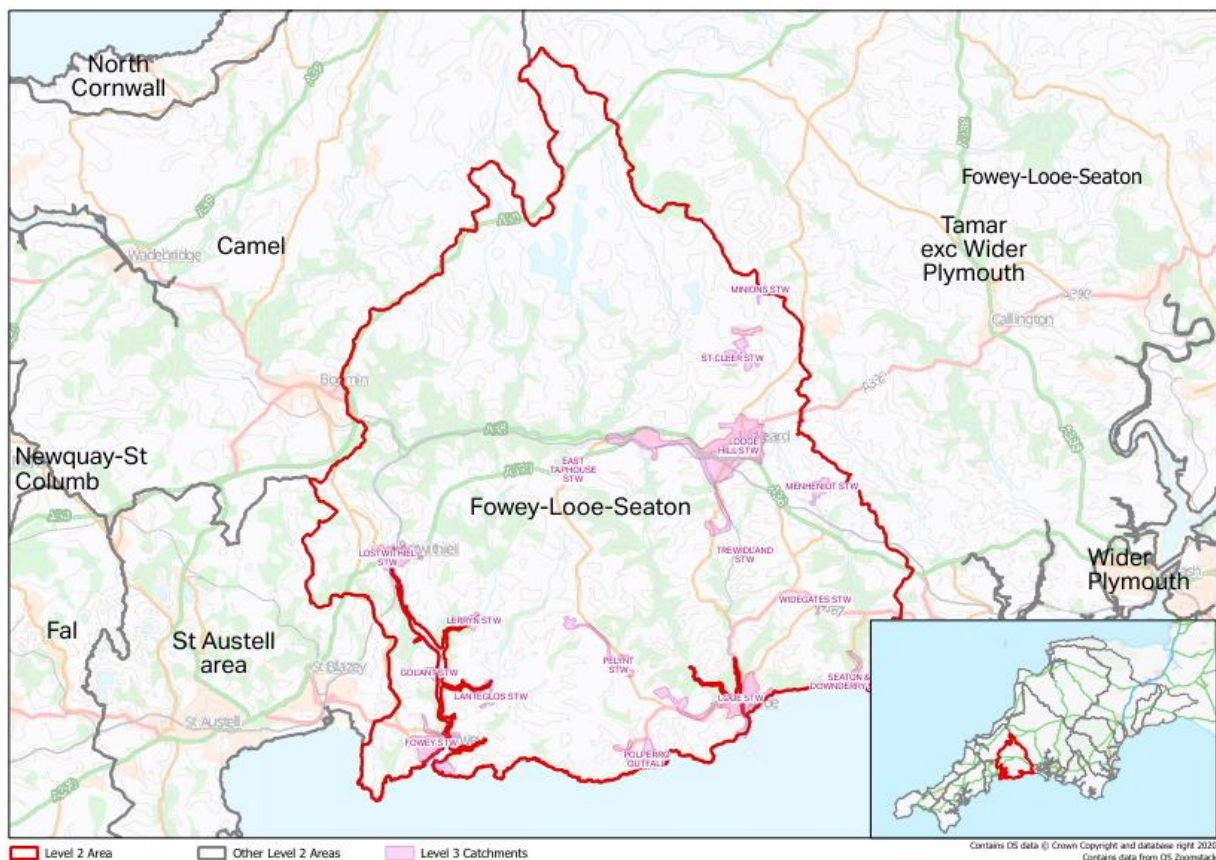


Figure 1: Catchment Overview

Designated Areas

Special Areas of Conservation

Special Areas of Conservation (SACs) are protected areas in the UK designated under:

- the Conservation of Habitats and Species Regulations 2017 (as amended) in England and Wales (including the adjacent territorial sea) and to a limited extent in Scotland (reserved matters) and Northern Ireland (excepted matters)
- the Conservation of Offshore Marine Habitats and Species Regulations 2017 (as amended) in the UK offshore area.

Under these regulations, the UK Government and devolved administrations are required to establish a network of important high-quality conservation sites that will make a significant contribution to conserving the habitats and species identified in Annexes I and II, respectively, of European Council Directive 92/43/EEC on the conservation of natural habitats and of wild fauna and flora, known as the Habitats Directive.

Special Areas of Scientific Interest

Under the Wildlife and Countryside Act 1981 (amended 1985) government has a duty to notify as a Site of Special Scientific Interest (SSSI) any land which in its opinion is of special interest by reason of any of its flora, fauna, geological or physiographical features.

SSSIs are designated by Natural England. An SSSI is not necessarily owned by a conservation organisation or by the Government - in fact, they can be owned by anybody. The designation is primarily to identify those areas worthy of preservation. A SSSI is given certain protection against damaging operations, and any such operations must be authorised by the designating body. The status also affords a certain amount of planning protection, depending on the reasons for designation.

Marine Conservation Zones

A Marine Conservation Zone (MCZ) is a type of marine nature reserve in UK waters. They were established under the Marine and Coastal Access Act (2009) and are areas designated with the aim to protect nationally important, rare or threatened habitats and species.

If any of these designated areas are within the Fowey-Looe-Seaton catchment they are shown in Figure 2 below.

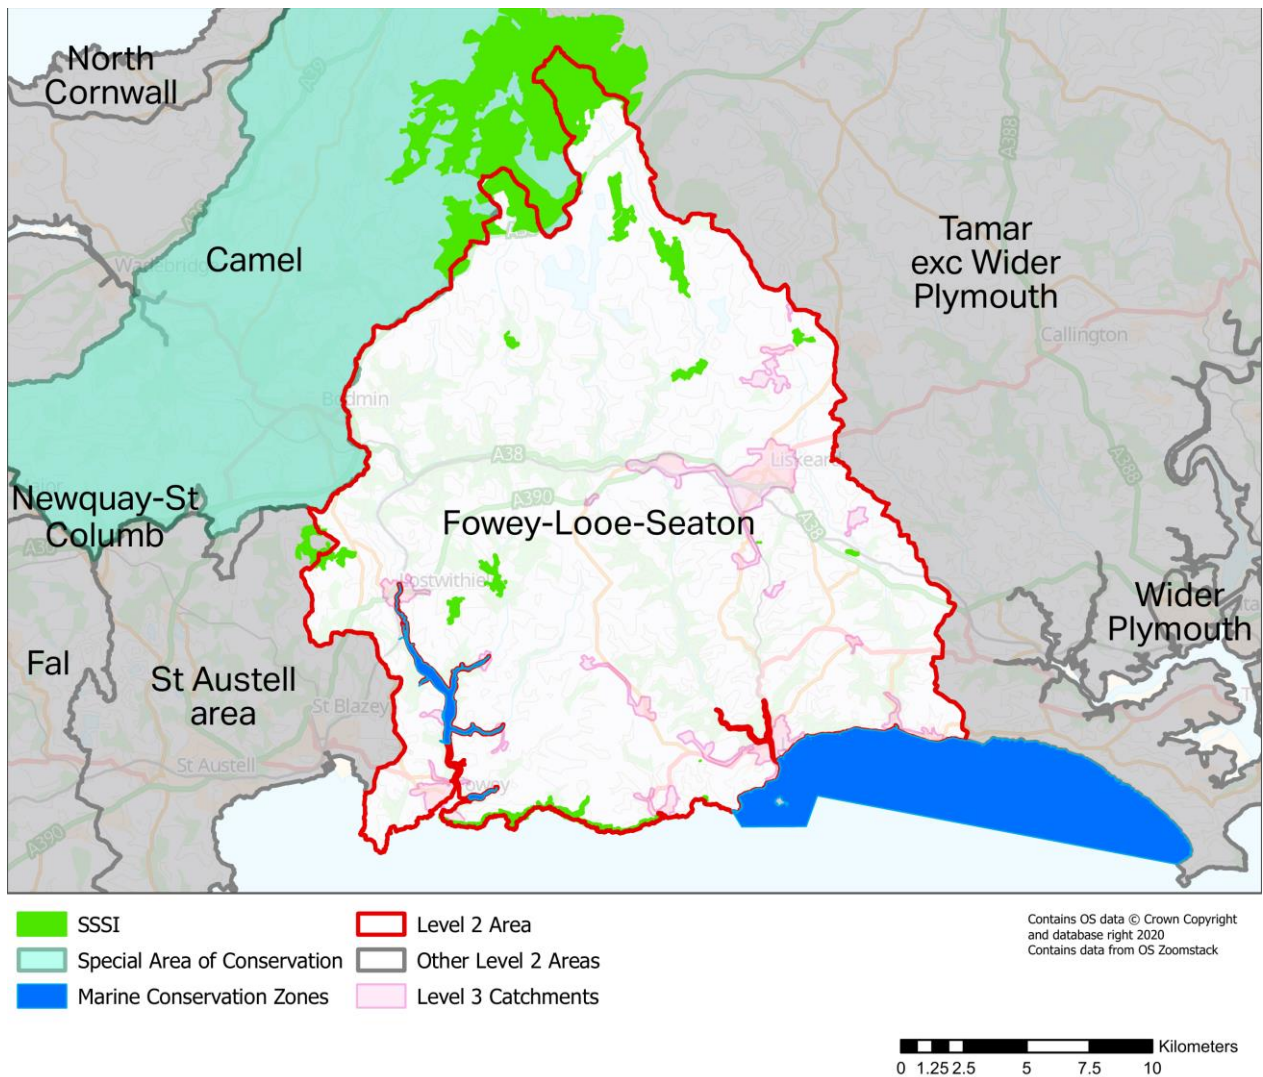


Figure 2: Designated Areas

Flooding Responsibilities

The Flood and Water Management Act, 2010 (FWMA), identified new responsibilities for flood and coastal erosion risk management authorities, of which Water and Sewerage Companies are one, together with a duty on all relevant authorities involved to co-operate and share data.

Table 3: FWMA Responsibilities

Location	Description	Responsibility
Surface runoff/Land drainage	Landowners are responsible for their land drainage and must not cause problems for neighbours	<ul style="list-style-type: none"> • Lead Local Flood Authorities • Landowners
Highways	Highways Surface water on roads, highways and pavements, blocked road drains/gullies and overgrown verges	<ul style="list-style-type: none"> • Highways Authorities • Highways England/Welsh Government • Transport for London
Groundwater	Waterlogged ground when water pools on the surface	<ul style="list-style-type: none"> • Lead Local Flood Authorities • Landowners
Rivers and watercourses	Water draining into rivers and streams from nearby land	<ul style="list-style-type: none"> • Lead Local Flood Authorities • Environment Agency /Natural Resources Wales • Riparian Owners • Landowners
Coastal/Tidal	Rough seas, high tides or storm inundation on lower land	<ul style="list-style-type: none"> • Local Authorities • Environment Agency • Natural Resources Wales
Surface water sewers	Most properties drain rainfall to a public sewer, including flows from gutters/roads that end up in public sewers. Highway drainage is provided for rainfall onto the highway but also includes water from fields/other property that finds its way onto the highway	<ul style="list-style-type: none"> • Water and wastewater companies • Local Authorities • Housing Associations • Private landowners • Highway Authorities
Public sewers	Sewer flooding from manholes and covers	<ul style="list-style-type: none"> • Water and wastewater companies
Private sewers	Flooding from cesspits/septic tanks, toilets or internal drains	<ul style="list-style-type: none"> • Homeowners

South West Water needs clear long-term plans in order to engage with other Risk Management Authorities (RMAs) to produce joined-up approaches and deliver the best outcomes for customers and the environment.

Current Performance

For all performance measures, the average number of events in a catchment/ Special Protection Area (SPA), is calculated from performance data and normalised to sewer length, (e.g., floodings/km of sewer). This catchment average is then compared to the average number of events across all SPAs and, using the Jenks Natural Breaks Classification System, catchments are defined as average, above average or below average.

Sewer Flooding

Sewer flooding incidents may occur for a number of reasons, including network misuse, asset deterioration, asset failures (collectively referred to as “other causes”) or hydraulic incapacity. Tables 4 and 5 provide a summary of internal and external flooding events respectively. Sewer flooding event locations are shown in Figure 3.

The rate (events/km) of internal sewer flooding in the Fowey-Looe-Seaton catchment is above average when compared to other Level 2 catchments.

Table 4: Count of Internal Flooding by location and cause

Year	Flooding Location	Flooding Cause Category	Count/km
2019	Internal	Other	2
2020	Internal	Hydraulic Overload	4
2020	Internal	Other	4
2021	Internal	Hydraulic Overload	3
2021	Internal	Other	9

The rate (events/km) of external sewer flooding in the Fowey-Looe-Seaton catchment is above average when compared to other Level 2 catchments.

Table 5: Count of External Flooding by location and cause

Year	Flooding Location	Flooding Cause Category	Count/km
2019	External	Hydraulic Overload	2
2019	External	Other	90
2020	External	Hydraulic Overload	2
2020	External	Other	82
2021	External	Hydraulic Overload	2
2021	External	Other	57
2022	External	Hydraulic Overload	1

Year	Flooding Location	Flooding Cause Category	Count/km
2022	External	Other	69
2023	External	Hydraulic Overload	1
2023	External	Other	97

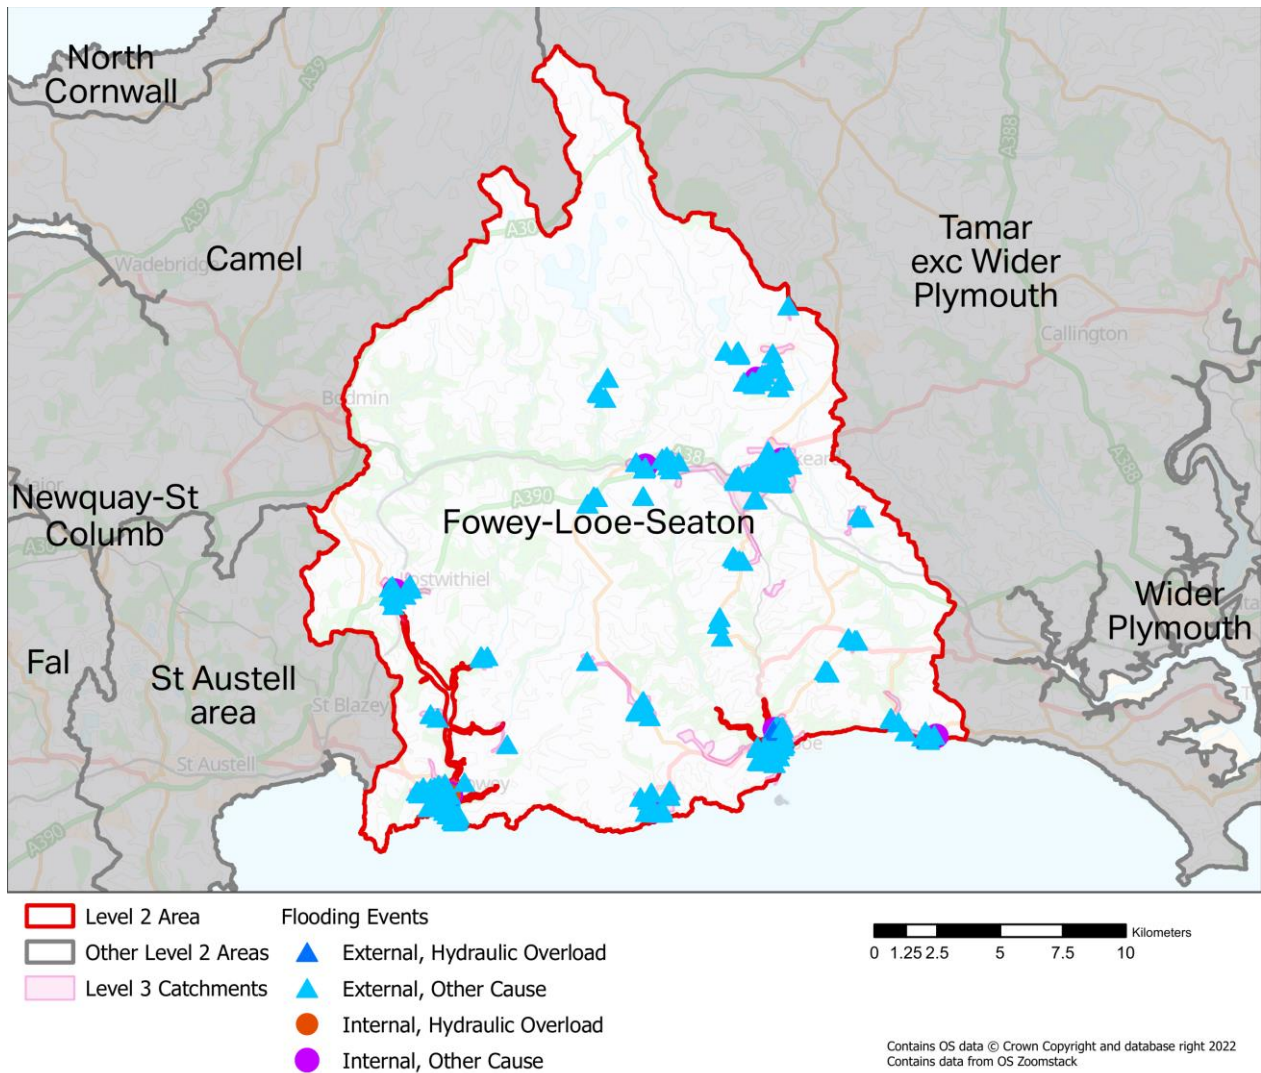


Figure 3: Sewer Flooding by location and cause

An assessment of future flooding risk has been carried out; the modelling approach is summarised further through this document in Table 22 (Future Flood Risk column).

Storm Overflows

Hydraulic overload is when the network cannot convey the runoff from heavy rainfall and can lead to sewer flooding and spills from overflows. It can be exacerbated by groundwater and surface water entering the sewerage system.

Figure 4 shows the approximate locations of all overflows. South West Water has a programme to monitor the current use and performance of storm overflows and 100% of the overflows are currently monitored. Table 6 below provides a summary of any available performance data for storm overflows in the catchment.

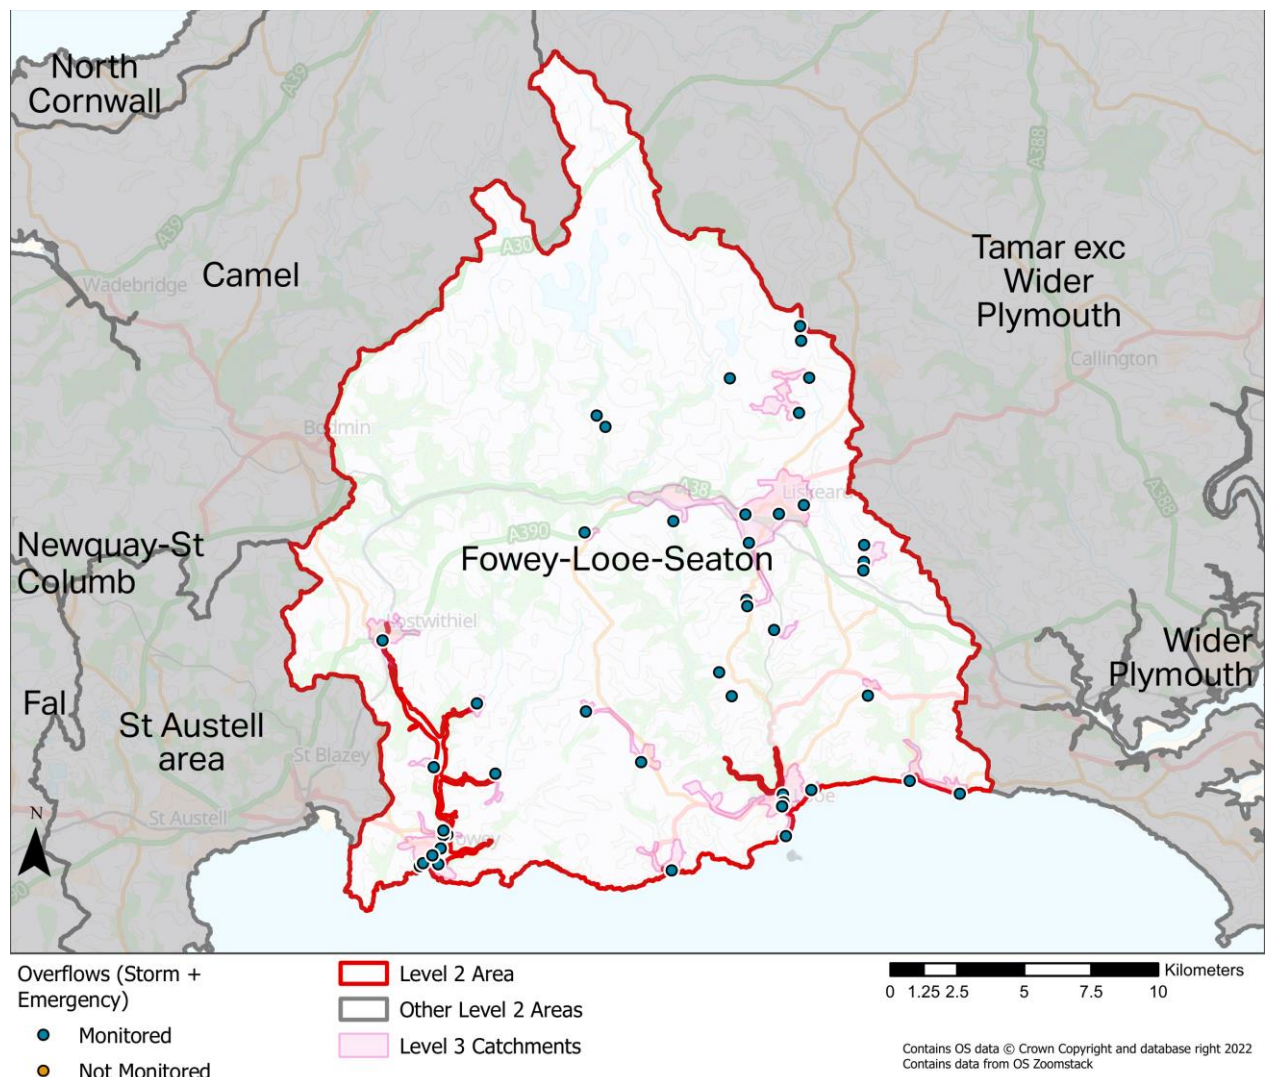


Figure 4: Overflow locations by monitoring status

Table 6: Storm Overflow Performance Summary

Year	2019	2020	2021
No. Monitored	28	31	31
No. Spills	1806	2213	1963

Blockages

Blockages are caused by a variety of items, materials, substances and vegetation entering the network. In the case of vegetation, this may be root ingress from trees/shrubs that enter through damaged areas and joints. In other cases, silt and debris may be washed in

through the surface water network and items such as wet wipes, fat or grease may be flushed into the network directly from homes and businesses.

Misuse of the network continues to be a significant issue across the region. Network misuse is defined as flushing anything other than the three Ps (Pee, Poo and toilet Paper) down toilets. Wet wipes, nappies and sanitary products should not be flushed regardless of their labelling. Fats, oils and grease should not be poured down sinks in the kitchen as these can congeal in and eventually block the sewer (known as a 'Fatberg'). Sewer misuse can lead to blockages which can cause sewer flooding and pollution.

South West Water has a number of community based education programmes including [Love your Loo](#) and [Think Sink!](#) that aim to prevent sewer misuse and reduce associated sewer flooding problems.

The rate of blockages in the Fowey-Looe-Seaton catchment is average when compared to other catchments in South West Water area. Blockages since the 2018/19 reporting year are shown below in Table 7 (split by the blockage cause code) and the locations indicated by the heat map in Figure 5. Please contact us if you require additional information on blockages in the Fowey-Looe-Seaton catchment.

Table 7: Count of blockages by year and cause

Year	Debris	Fat	Paper/Rag	Roots	Silt	Third Party Damage
2019	51	30	238	14	5	1
2020	24	20	210	13	2	
2021	34	9	175	8	4	
2022	52	16	170	16	3	
2023	46	12	228	8	2	

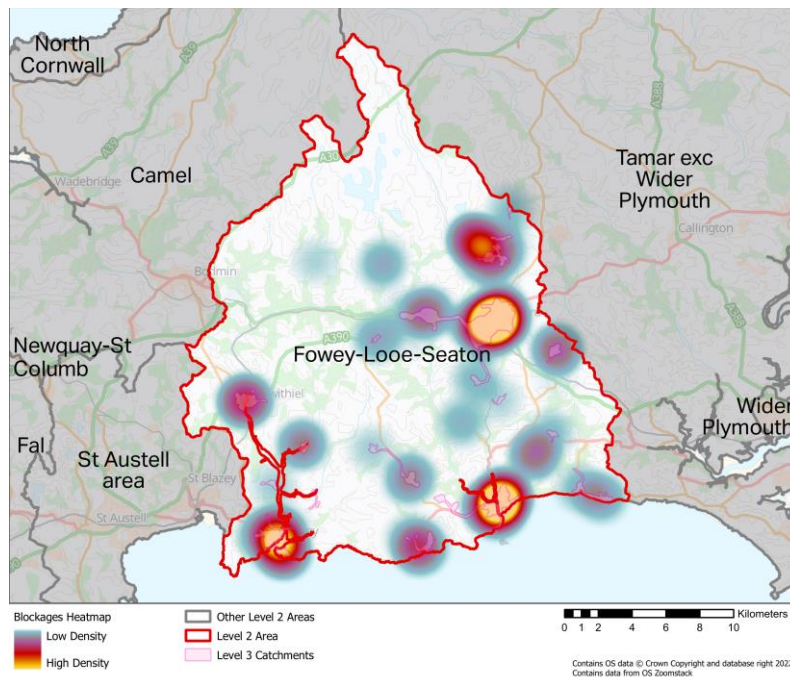


Figure 5: Blockage Event Heatmap

Asset Condition

Gravity Network

A programme of CCTV inspections is undertaken to determine the structural condition of sewers. A risk-based approach is applied, considering frequency of failure and consequence of failure. The sewers in most need of attention due to their condition are prioritised for more frequent inspection or rehabilitation.

The rate of collapses in the Fowey-Looe-Seaton catchment is average when compared to other catchments in the region. A heatmap of sewer collapses since the 2018/19 reporting year is shown in Figure 6 below. Table 8 provides a count of collapse and partial collapse events since the 2018/19 reporting year.

Table 8: Count of sewer collapse by year

Year	Collapse	Partial Collapse
2019	4	13
2020	4	7
2021	6	0
2022	4	8
2023	0	2

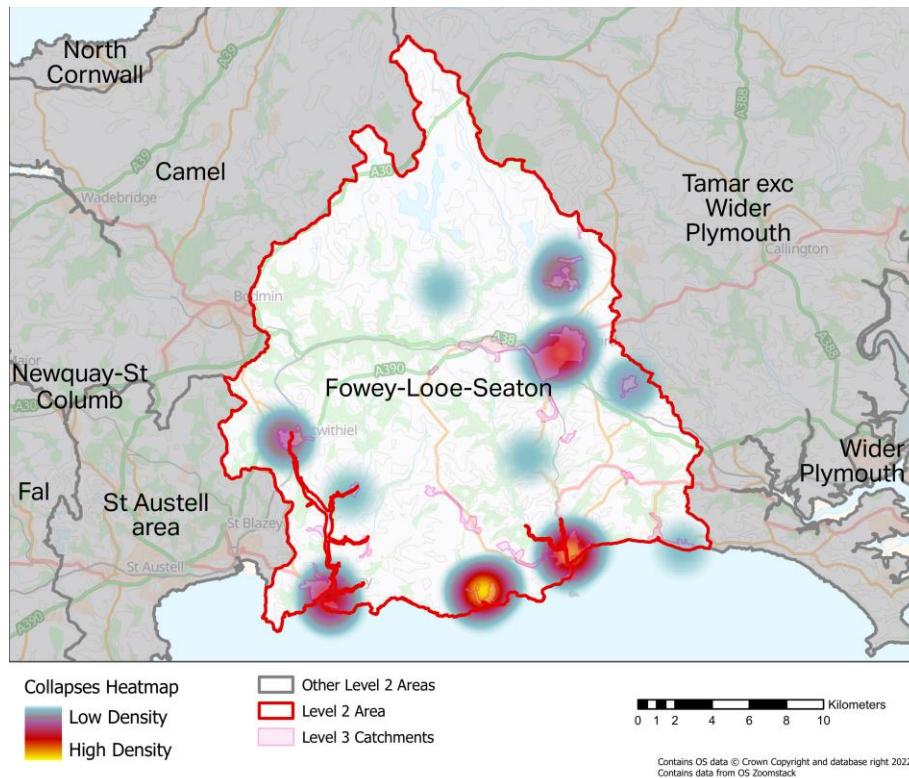


Figure 6: Sewer Collapse Heatmap

Pumped Network (Rising Mains)

South West Water continuously invests in sewage pumping stations (SPS) and rising mains. Rising main failures are repaired promptly by reactive teams, and if repeat failures are experienced or immediate works are identified, they are prioritised for replacement.

Table 9 provides a count of flooding events caused as a result of issues at pumping stations and Table 10 provides a count of rising main bursts since the 2018/19 reporting year. Flooding and burst locations are shown in Figure 7.

Table 9: Count of SPS flooding by year/cause

Year	Feedback Cause	Count
2023	Pump Station Breakdown	1

Table 10: Count of Rising Main bursts by year/cause

Year	Feedback Cause	Count
2019	Collapse/Burst	1
2021	Collapse/Burst	1

Year	Feedback Cause	Count
2022	Collapse/Burst	1
2023	Collapse/Burst	1

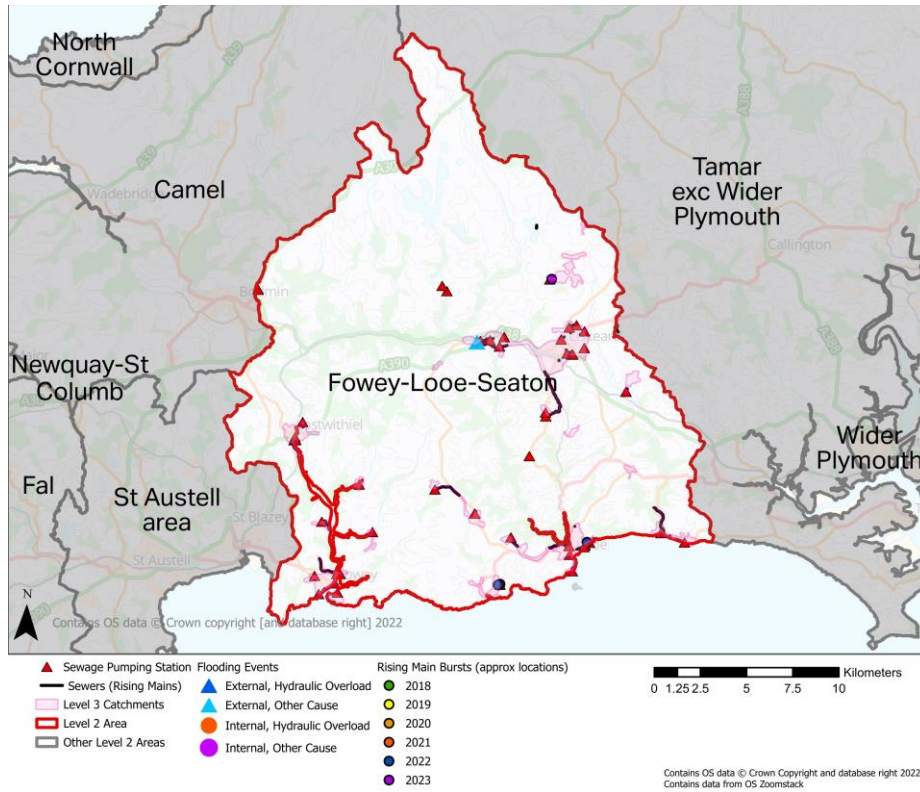


Figure 7: SPS/Rising Main flooding and burst events

Environmental Performance

Surface Water Flooding

South West Water is only responsible for sewer flooding. Areas prone to surface water flooding (due to rainfall and pooling at low points in the landscape) can be seen on the [EA website](#). The responsibilities for other types of drainage and flooding are summarised in Table 3 earlier in this document.

Pollution

South West Water is continuing to strive to eliminate harmful pollution to the environment. This includes there being no Category 1 and 2 (the most harmful) pollution incidents. South West Water's vision for Environmental performance can be found on the website [here](#).

There have been 26 category 3 (minor) pollution incidents in the Fowey-Looe-Seaton catchment since the 2018/19 reporting year.

Table 11 provides a summary of pollution events by year and the category of environmental impact. The map in Figure 8 shows the location of pollution events. Clusters of pollution events are identified for further investigations and activities to reduce and/or remove the future risk of pollution events occurring.

Table 11: Count of pollution events by year and impact level

Year	Water Env Category Level	Count
2019	3	8
2020	3	5
2021	3	7
2022	3	6

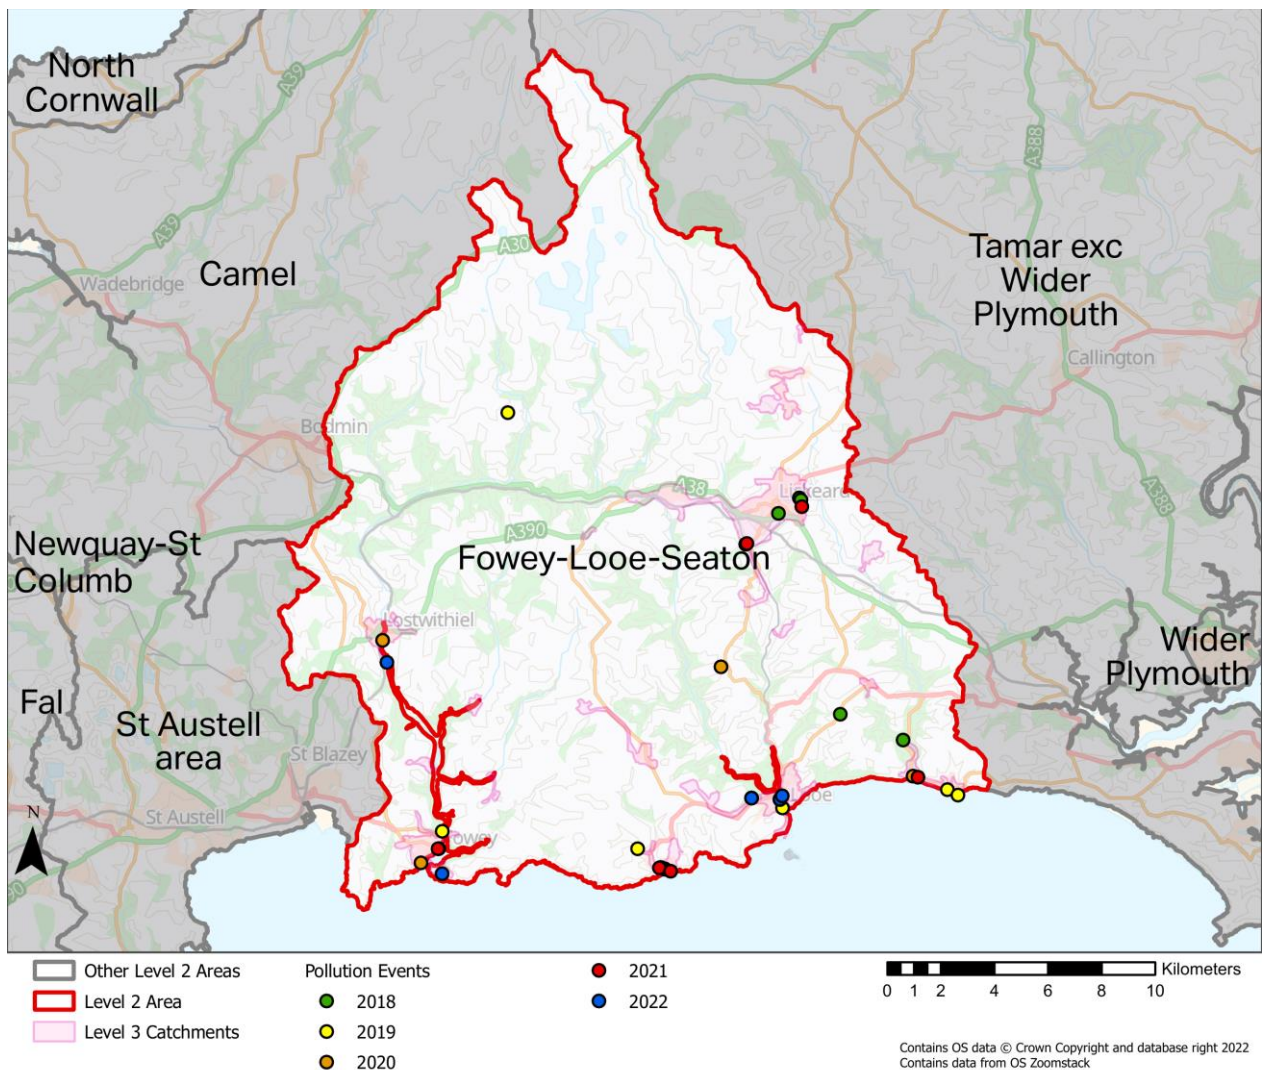


Figure 8: Pollution Events

Critical Drainage Areas

A Critical Drainage Area (CDA) is an area with critical drainage problems, which has been formally notified to the Local Authority by the Environment Agency. Within CDAs, proposed development may present risks of flooding on-site and/or off-site if the surface water runoff is not effectively managed.

The purpose of creating the CDA allocation is to reduce downstream flooding by controlling the accumulative impact of surface water runoff from multiple development sites in sensitive catchment areas. This means that any site discharging surface water to a watercourse or public sewer must attenuate the flow to mimic the green field runoff for a 1:10 year rain fall event. Where the surface water can be managed within the site for the “1:100+40%” condition (i.e., an allowance of 40% over and above the 1:100 event), there is no change to the standard surface water drainage requirement.

The Development Management Procedure Order requires that the EA is consulted on developments within Areas with Critical Drainage Problems (ACDPs). The map in Figure 9 shows the geographical coverage of ACDPs in the Fowey-Looe-Seaton catchment.

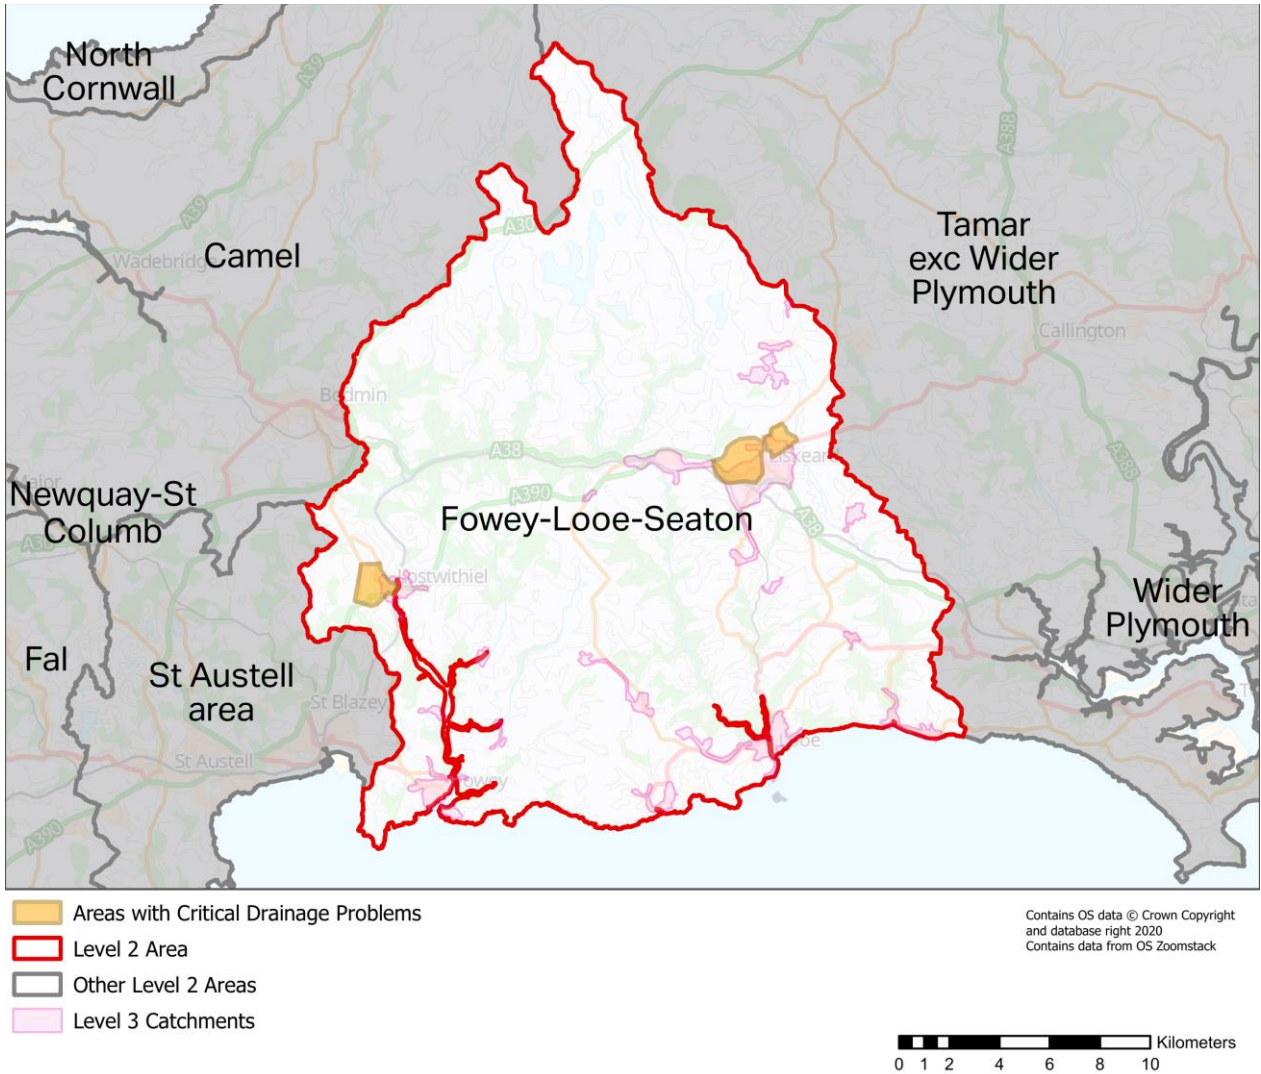


Figure 9: Critical Drainage Areas

Wastewater Treatment Compliance

Each Wastewater Treatment Works has a permit, as agreed with the EA, for the quantity and quality of the water that is discharged to the environment.

The Fowey-Looe-Seaton catchment has failed some wastewater treatment compliance checks since the 2018/19 reporting year. These are shown in Table 12.

Table 12: Wastewater Treatment compliance failures

Asset Equipment Name	Year	Fail Type	Parameter
FOWEY_STW_FOWEY	2019	Disinfection	24 Hour Rule

Table 13 shows the Dry weather flow (DWF) performance of the treatment works in the Fowey-Looe-Seaton catchment.

Table 13: Dry weather flow results and permits from 2018-2020

Asset Name	Permitted (m3/d)	Comments
DULOE_STW_DULOE	32	Spare capacity available
EAST TAPHOUSE_STW_EAST TAPHOUSE	50	Spare capacity available
FOWEY_STW_FOWEY	1,843	Spare capacity available
GOLANT_STW_LOSTWITHIEL	99	Approaching design capacity
LERRYNT_STW_LOSTWITHIEL	115	Spare capacity available
LODGEHILL_STW_LISKEARD	2,829	Spare capacity available
LOOE_STW_WEST LOOE	3,076	Spare capacity available
LOSTWITHIEL_STW_LOSTWITHIEL	1,079	Spare capacity available
MENHENIOT_STW_MENHENIOT	273	Spare capacity available
PELYNT_STW_PELYNT	310	Spare capacity available
POLPERRO FINESCREEN_STW_POLPERRO	1,386	Spare capacity available
SEATON AND DOWNDERRY_STW_SEATON	468	Spare capacity available
ST CLEER_STW_LISKEARD	753	Spare capacity available
ST NEOT_STW_ST NEOT	127	Spare capacity available
WIDEGATES_STW_LOOE	83	Spare capacity available

Water Quality

When untreated/partially treated wastewater is discharged to a watercourse it may have potential to affect the downstream environment including river and coastal areas. This will be dependent on the duration of any discharge and the dilution offered by the receiving watercourse. This discharge could be from blockages in the sewerage network, wastewater spills or leaks, from misconnections (when wastewater from households is incorrectly connected to the surface water sewer) or from storm overflows. The EA has overall responsibility for water quality in water courses, although South West Water work in partnership to reduce and remove possible sources of pollution.

Our dedicated Upstream Thinking (UST) team engages with farmers and landowners to make changes in how land is managed, ensuring our drinking water sources are protected from diffuse pollution. Starting on the high moorlands and focusing on the land next to rivers, we collaborate to make water management plans that protect streams and rivers while keeping farms productive.

The EA assesses why waterbodies do not achieve a “good” status. Table 14 below provides a summary of the significant water management issues and the associated activities identified as part of the analysis for the Fowey-Looe-Seaton catchment.

Table 14: Reasons for not achieving ‘Good’ water quality status

Significant water management issue (SWMI)	Activity	Count
Changes to the natural flow and levels of water	Regulating Reservoir Flow Regime	1
	Impoundment - u/s elevated water level	2
Physical modifications	Land use - improved grassland	1
	Other (not in list, must add details in comments)	4
	Reservoir / Impoundment - non flow related	1
	Urbanisation - urban development	1
	Water level management in impounded water bodies	2
	Pollution from abandoned mines	Abandoned mine
Pollution from rural areas	Farm/site infrastructure	2
	Poor Livestock Management	7
	Poor nutrient management	1
	Poor soil management	2
	Riparian/in-river activities (inc bankside	6

Significant water management issue (SWMI)	Activity	Count
	erosion)	
	Leaking utility sewers	1
Pollution from towns, cities and transport	Misconnections	2
	Private Sewage Treatment	1
Pollution from wastewater	Discharge	2
	Barriers - ecological discontinuity	1
	Incidents	2
	Internal nutrient load (lakes only)	6
	Natural mineralisation	1

Future challenges in the catchment

Growth

New developments can cause an increase in the volume of wastewater requiring conveyance and treatment. Improvements to the foul sewerage system to support new development will be assessed by South West Water's New Developments Team and infrastructure charges paid by new developments will fund required upgrades to ensure sewer flooding risk is not increased. There are multiple sources of growth information for the region.

To understand where development and specific areas of growth can be expected, the local plans as published by the Local Planning Authority (LPA) are a reasonable source of information.

The LPA polygons showing areas earmarked for development can be found in Figure 10 at the end of this section.

Climate Change and Urban Creep

Climate change is likely to increase the intensity of rainfall leading to higher risk of flooding in the future; however, the magnitude and timing of this change is highly uncertain.

The potential increase in rainfall intensity could inundate the combined sewer networks and cause surface water and sewer flooding. Changing patterns of summer storms could affect the frequency and volume of spills from storm overflows and consequently impact on the river and bathing water quality downstream.

Urban creep can also pose a challenge for managing South West Water's drainage and wastewater networks. Urban creep occurs when minor extensions to homes are built or when existing permeable areas e.g., gardens are paved over to provide patios or for car parking. The result is an overall increase in impermeable area contributing directly to fast runoff to the urban drainage system and consequent increase in the risk of flooding

Future Challenges

44 potential development locations are recorded for this catchment. Table 15 summarises the different types of development planned in the catchment and Figure 10 shows the location and extent of land proposed for development that have been identified in local development plans at the time of writing. Please refer to the local authorities Local Plan for the most current information.

Table 15: Summary of Proposed Developments

Development Type	Number in Catchment
Care Home / Assisted Living	1
Employment	3
Hotel	1

Development Type	Number in Catchment
Housing Development	46
Industrial Development	1
Mixed Use Development	4
Tourist Park	1

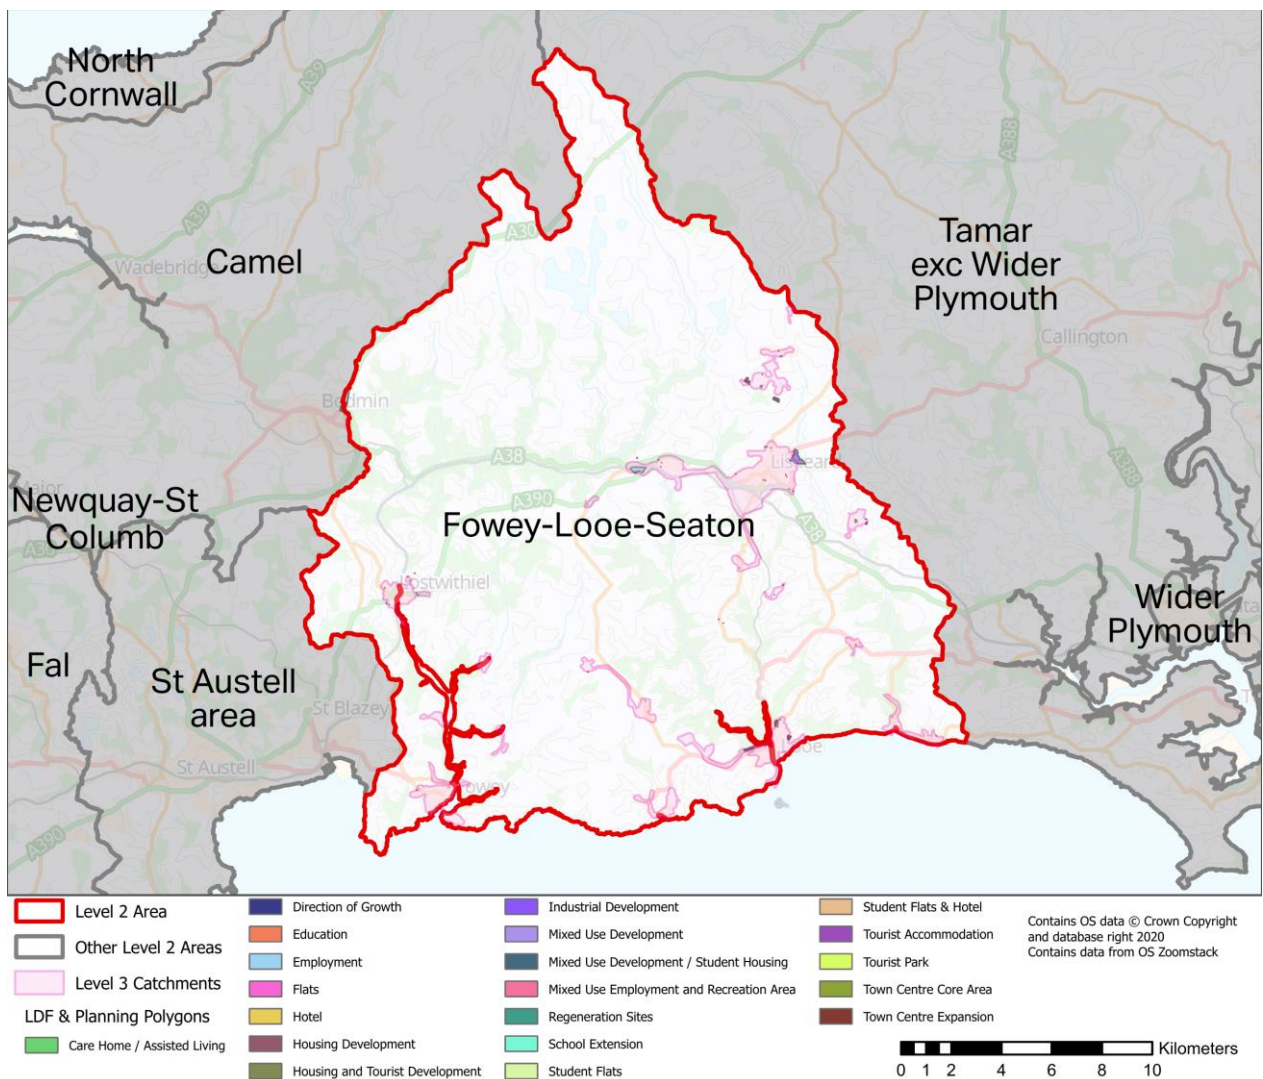


Figure 10: Local Development Framework Areas

Catchment Strategy

Partnership Working

South West Water is working in partnership with multiple organisations including the EA, local authorities and other stakeholders such as landowners, local residents and community groups. The purpose of this work is to understand the causes of drainage and wastewater issues and to progress joint projects to resolve them where appropriate. For example, partnership working opportunities may exist where properties are located within recognised flood zones (FZ2, FZ3 and/or Surface Water) which can be found [here](#).

Investment Routes

Reactive Investment

Reactive investment needs are identified via investigations following reactive response to operational/customer issues and planned surveys that are targeted to detect and resolve problems before they have an impact on customers and the environment.

The investment needs are prioritised based on the risk to properties and the identification of repeat events. These needs then form a programme of targeted investments for delivery over the next 12 months. Details for any needs recorded for the Fowey-Looe-Seaton catchment are summarised in Table 16.

Eighteen investment needs are recorded for this catchment. Locations are shown in Figure 11.

Table 16: Summary of Reactive Investment Opportunities

	Capital Maintenance	Quality	Total
Completed	1		1
Confirm Scope	7	3	10
Contractor Scoping	1		1
Review Scope	1	2	3
Total	10	5	15

WINEP Investment

The Water Industry National Environment Programme (WINEP) is the programme of work where water companies work collaboratively with Environmental regulators and other stakeholders to investigate, identify and agree investment needs to deliver specific environmental improvements. Water companies in England then undertake to deliver this to meet their obligations from environmental legislation and UK government policy. The tables below indicate the WINEP investigation and implementation schemes for the Fowey-Looe-Seaton catchment if present, with locations are shown in Figure 11.

There are currently 13 investigations planned in this catchment, as shown in Table 17.

Table 17: WINEP Investigations

WINEP ID	Name of Waterbody	Waterbody Type	Driver Code	Planned Completion Date	Investigations Scope	Additional Comments
DCS00681	Lerryn River	River	U_INV2	2022-03-31	n/a	U_INV2 Investigation required as to suitability of existing inlet or outlet monitor to measure PFF.
DCS00899	Polperro River	River	U_INV2	2022-03-31	n/a	U_INV2 Investigation required as to suitability of existing inlet or outlet monitor to measure PFF.
DCS00932	St Austell	Coastal	U_INV2	2022-03-31	n/a	U_INV2 Investigation required as to suitability of existing inlet or outlet monitor to measure PFF.
DCS01287	Seaton	River	U_INV2	2022-03-31	n/a	U_INV2 Investigation required as to suitability of existing inlet or outlet monitor

WINEP ID	Name of Waterbody	Waterbody Type	Driver Code	Planned Completion Date	Investigations Scope	Additional Comments
						to measure PFF.
CHM00185	Fowey (Warleggan to St Neot)	River	WFD_INV_CHE M10	2021-09-30	Investigation to be carried out in accordance with the requirements detailed in the current UKWIR CIP3 Technical Specification and Guidance	n/a
CHM00186	Fowey (Warleggan to St Neot)	River	WFD_INV_CHE M9	2021-09-30	Investigation to be carried out in accordance with the requirements detailed in the current UKWIR CIP3 Technical Specification and Guidance	n/a
CHM00193	LOOE	Transitional	WFD_INV_CHE M9	2021-09-30	Investigation to be carried out in accordance with the requirements detailed in the current UKWIR CIP3 Technical Specification and Guidance	n/a
CHM00199	Polperro River	River	WFD_INV_CHE M10	2021-09-30	Investigation to be carried out in accordance with the requirements detailed in the current UKWIR CIP3 Technical Specification and Guidance	n/a
BAW00058	Catchment Scale: - see additional comments	Catchment Scale: - see additional comments	BW_INV4	2022-09-30	Catchment investigation to understand what water company action would be needed to achieve a robust classification of Excellent (less than 20% risk of failing planning class of Excellent).	n/a
BAW00106	Catchment Scale: - see additional comments	Catchment Scale: - see additional comments	BW_INV4	2022-09-30	Investigation part 1. Catchment investigation to understand what water company action would be needed to achieve a robust classification of Good (less than 20% risk of failing planning class of Good). Investigation part 2. Catchment investigation to understand what water company action would be needed to achieve a robust classification of Excellent (less than 20% risk of failing planning class of Excellent).	n/a
BAW00125	Catchment Scale: - see	Catchment Scale: - see	BW_INV4	2022-09-30	Investigation part 1. Catchment investigation to understand what water company action would be	n/a

WINEP ID	Name of Waterbody	Waterbody Type	Driver Code	Planned Completion Date	Investigations Scope	Additional Comments
	additional comments	additional comments			needed to achieve a robust classification of Good (less than 20% risk of failing planning class of Good). Investigation part 2. Catchment investigation to understand what water company action would be needed to achieve a robust classification of Excellent (less than 20% risk of failing planning class of Excellent).	
DCS01342	Plymouth Coast	Coastal	MCZ_INV	2022-03-31	Investigate relevant pumping stations/CSO/STW discharges to determine whether there is an adverse impact on the Seagrass within the MCZ. Seasonally monitor the levels of N, contaminants (metals) and suspended sediment being inputted into Looe Bay from discharges close to seagrass beds in MCZ. See comments for further information.	Seagrass is in favourable condition on this site. This habitat type is sensitive to types of pollution and sedimentation caused by STW discharges. Seafan annenome and Pink seafan are not in favourable condition and are highly sensitive to smothering and siltation changes. However due to other sediment inputs in this coastal cell it would be hard to assess impacts associated with STW discharge. Recommendation : Seasonally monitor the levels of N, contaminants (metals, PAHs) and suspended sediment being inputted into Mounds

WINEP ID	Name of Waterbody	Waterbody Type	Driver Code	Planned Completion Date	Investigations Scope	Additional Comments
						Bay from discharges close to seagrass beds in MCZ (near Penzance and St Michaels Mount).
FLO00639	FOWEY	Transitional	U_INV2	2022-03-31	n/a	Relationship between spills and Final Effluent flow measurement to be investigated to prove FTT compliance

There are currently 6 implementations planned in this catchment, as shown in Table 18.

Table 18: WINEP Implementations

WINEP ID	Name of Waterbody	Waterbody Type	Driver Code	Planned Completion Date	Implementation Scope	Additional Comments
DCS00391	Catchment Scale: - see additional comments	Catchment Scale: - see additional comments	BW_IMP1	2022-03-31	Deliver sustainable solutions to: Optimise combined sewer operation and move CSO spill frequency and volume towards 3 spills per bathing season (aggregated) 'Sufficient' design standard; Reduce microbial loads in public surface water sewer discharges; Reduce background microbial loads in surface water drainage systems that arise from sources in the public foul/combined sewer network, other than permitted discharges. Liase with EA and other drainage authorities to	See column AD - Implementation scope

WINEP ID	Name of Waterbody	Waterbody Type	Driver Code	Planned Completion Date	Implementation Scope	Additional Comments
					explore integrated solutions to flooding and pollution.	
DCS00682	Lerryn River	River	U_IMP6	2024-03-31	n/a	n/a
DCS00896	Polperro River	River	WFD_IMP_CHEM	2024-12-22	n/a	n/a
DCS00900	Polperro River	River	U_IMP6	2024-03-31	n/a	n/a
DCS01019	Plymouth Coast	Coastal	BW_IMP3	2025-03-31	An average of no more than 2 spills per bathing season >50 m3. Must comply with EA pumping station emergency overflow policy requirements.	See column AD - Implementation scope. Scheme subject to 'willingness to pay'
DCS01087	Seaton	River	U_IMP6	2025-03-31	n/a	n/a

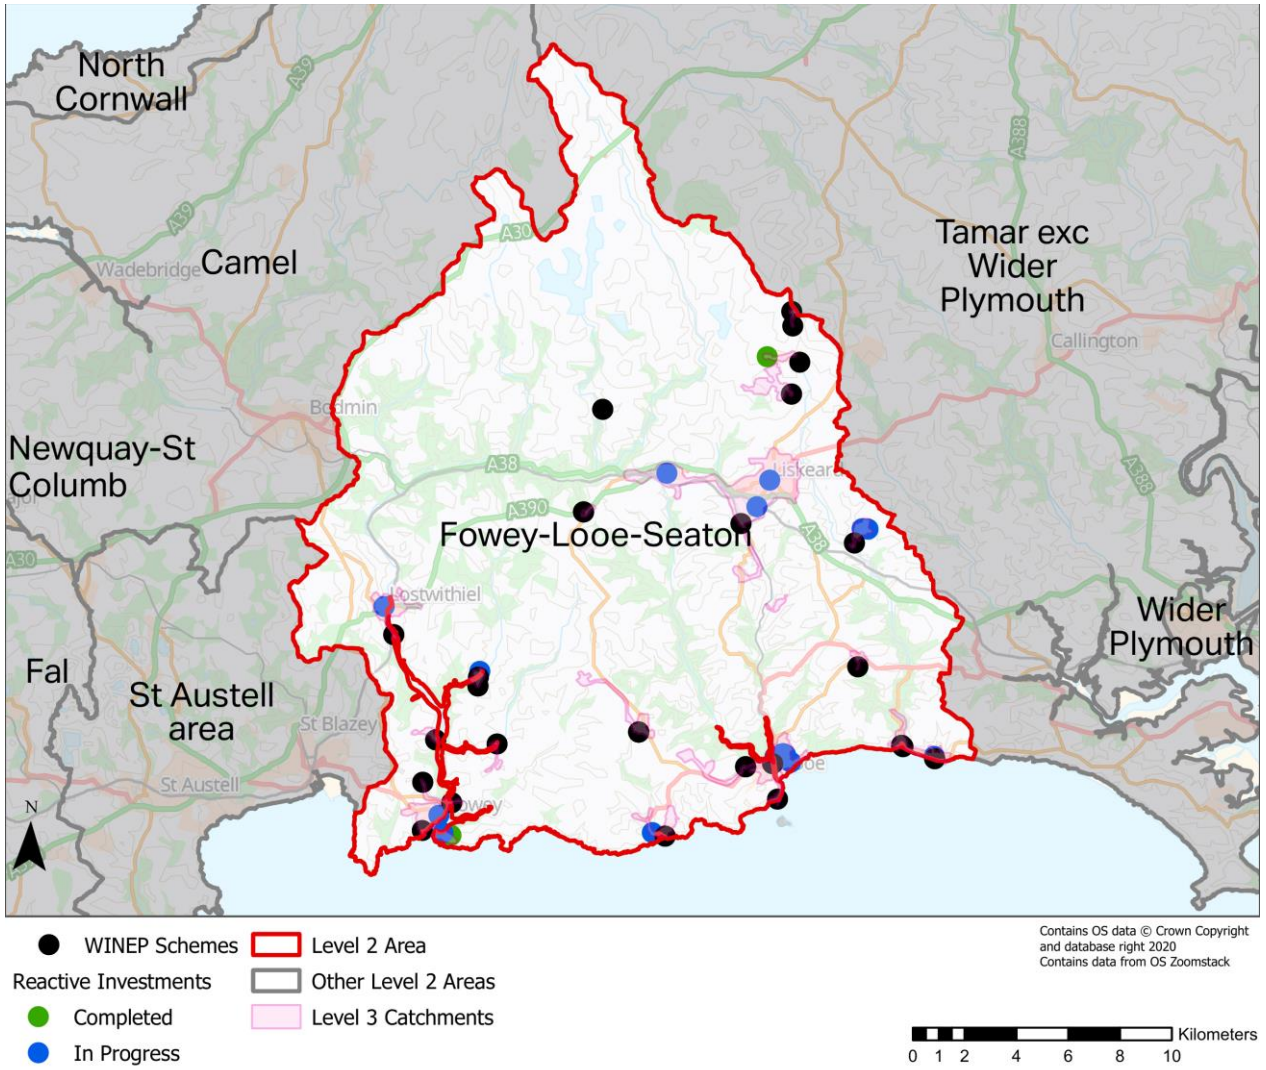


Figure 11: Reactive and WINEP Investment locations

Medium and Long-Term Plans

Overview

The following sections of this document outline South West Water's current analysis and medium to long-term proposals. In particular, they present the option developments and appraisals that will be used during the next price review and planning for future Asset Management Planning cycles (AMPs).

Outputs from the following DWMP process stages are summarised in the following sections and form the primary content for consultation:

- Risk-based catchment screening
- Baseline risk and vulnerability assessment
- Bespoke planning objectives
- Resilience scoring
- Problem characterisation
- Options appraisal

The DWMP will inform South West Water's future business plans based on the best available knowledge today. There is uncertainty in the future linked to finance, regulation/legislation, environmental and climate changes. This is a long-term, iterative process, so the plans may change in the future to reflect the future needs of the Fowey-Looe-Seaton catchment.

Risk Based Catchment Screening

The Risk based Catchment Screening exercise (RBCS) was carried out across all of South West Water's 653 Level 3 Tactical Planning Units (TPUs), screening each one in order that the effort could be best focused where it was most appropriately needed. From this assessment exercise it was determined that 373 catchments were identified as being potentially 'at risk' of environmental or community impact deteriorating in the future and were to proceed to the Baseline Risk & Vulnerability Assessment (BRAVA) stage for assessment under those criteria. Each catchment was assessed against a range of indicators shown in Table 19, to identify the catchments that require a more detailed investigation. The information and data required for the assessment is readily available from company reporting systems and from stakeholders. Indicators have been classified into two tiers, which enables us to prioritise the indicators when assessing if further assessment is required. Only two indicators are Tier 2:

- Catchment characterisation
- Continuous or intermittent discharges impact upon sensitive receiving waters

All other indicators are Tier 1 indicators.

When a catchment or TPU is identified as needing further assessment, this is described as an "indicator breach" in the RBCS process. This is not a performance breach but rather a trigger to further evaluate or assess certain indicator/indicators in the next stage of the DWMP process.

The results for the Level 3 catchments within the Fowey-Looe-Seaton catchment are in the RBCS Summary (Table 19) below.

Table 19: RBCS Summary Table

Level 3 Equipment Number	C21st Pipe Metric	Total Population Equivalent	Catchment Characterisation	Bathing or shellfish waters	Discharge to Sensitive Waters (Part A)	Discharge to Sensitive Receiving (Part B)	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Number of Indicators Breached (Excl)	Single Indicator Breach is Tier 1	Proceed to BRAVA?	
52296	Initial	1,496.5	NO	NO	NO	NO	YES	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	YES	1	YES	YES
52301	Initial	2,519.9	YES	NO	NO	NO	YES	NO	NO	YES	NO	NO	NO	NO	NO	NO	NO	YES	YES	3	NO	YES	
52325	Initial	358.4	NO	NO	NO	NO	YES	NO	NO	NO	NO	NO	NO	YES	NO	NO	NO	NO	YES	2	NO	YES	
52326	Initial	12,400.8	YES	YES	NO	NO	YES	NO	YES	YES	YES	NO	NO	NO	NO	YES	NO	YES	YES	7	NO	YES	
52328	Initial	6,604.9	YES	YES	NO	NO	YES	NO	YES	YES	YES	NO	NO	NO	NO	NO	NO	YES	YES	6	NO	YES	
52331	Initial	877.6	NO	YES	NO	NO	YES	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	YES	2	NO	YES	
54075	Initial	3,742.6	YES	YES	NO	NO	YES	NO	YES	YES	YES	YES	NO	NO	NO	NO	NO	YES	YES	7	NO	YES	
10715373	Initial	1,616.2	NO	NO	NO	NO	YES	NO	YES	NO	YES	NO	NO	NO	NO	NO	NO	YES	YES	3	NO	YES	
10776810	Initial	101.0	NO	NO	NO	NO	NO	NO	NO	NO	YES	NO	NO	NO	NO	NO	NO	NO	YES	1	YES	YES	
52320	Initial	362.5	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	YES	0	NO	NO	
10693850	Initial	0.5	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	0	NO	NO	
52329	Initial	2,865.1	YES	YES	NO	NO	NO	NO	NO	NO	YES	YES	NO	NO	NO	NO	NO	YES	YES	4	NO	YES	

Level 3 Equipment Number	C21st Pipe Metric	Total Population Equivalent	Catchment Characterisation	Bathing or shellfish waters	Discharge to Sensitive Waters (Part A)	Discharge to Sensitive Receiving (Part B)	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Number of Indicators Breached (Excl	Single Indicator Breach is Tier 1	Proceed to BRAVA?	
10524124	Initial	70.7	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	0	NO	NO	
54156	Initial	1,195.4	YES	YES	NO	NO	NO	NO	NO	NO	YES	NO	NO	NO	NO	NO	NO	NO	NO	YES	3	NO	YES
52335	Initial	126.4	NO	NO	NO	NO	NO	NO	NO	NO	YES	NO	NO	NO	NO	NO	NO	NO	NO	YES	1	YES	YES
52315	Initial	213.7	NO	NO	NO	NO	NO	NO	NO	YES	NO	NO	NO	NO	NO	NO	NO	NO	NO	YES	1	YES	YES
52307	Initial	74.2	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	0	NO	NO
52324	Initial	82.8	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	0	NO	NO
52316	Initial	84.7	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	YES	0	NO	NO
52310	Initial	115.0	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	0	NO	NO
52333	Initial	112.5	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	YES	0	NO	NO
52313	Initial	364.2	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	YES	0	NO	NO
52319	Initial	306.3	YES	NO	NO	NO	NO	NO	NO	NO	YES	NO	NO	NO	NO	NO	NO	NO	NO	YES	2	NO	YES
10431589	Initial	213.0	NO	YES	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	YES	1	YES	YES
52314	Initial	85.5	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	0	NO	NO

Level 3 Equipment Number	C21st Pipe Metric	Total Population Equivalent	Catchment Characterisation	Bathing or shellfish waters	Discharge to Sensitive Waters (Part A)	Discharge to Sensitive Receiving (Part B)	SOAF	CAF	Internal Sewer Flooding	External Sewer Flooding	Pollution Incidents	WwTW Q Compliance	WwTW DWF Compliance	Storm Overflows	Other RMA Systems	Planned Residential Development	WINEP	Sewer Collapses	Sewer Blockages	Number of Indicators Breached (Excl	Single Indicator Breach is Tier 1	Proceed to BRAVA?	
52311	Initial	146.2	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	YES	0	NO	NO
53024	Initial	352.1	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	YES	0	NO	NO

Score/Colour Definition

No	No breach
Yes - Tier 1	Tier 1 breach
Yes - Tier 2	Tier 2 breach

Figure 12: RBCS scoring legend

Baseline Risk & Vulnerability Assessment (BRAVA)

For those catchments that were captured by the RBCS as being ‘at risk’ South West Water then progressed them through to the BRAVA process.

Through the BRAVA process South West Water’s understanding of the risks facing the catchments, and at what scale and complexity, has been improved. This included an assessment into how external changes in the future may impact upon South West Water’s catchment vulnerabilities and how they may be impacted by risks such as Climate Change and Urban Creep. The outputs from this process are summarised below in Table 20. The planning objectives used for this exercise were:

- Internal Sewer Flooding Risk
- Pollution Risk
- Sewer Collapse Risk
- Risk of Sewer Flooding in a 1 in 50-year storm
- Storm Overflow performance
- Risk of WwTW Compliance Failure

Table 20: BRAVA output summary table

Group	Description	Value
	L2_Area	Fowey-Looe-Seaton
Physical Characteristics	Total Population Equivalent	32093
	Baseline sewer length (km)	356
Baseline Score 2020	Planning Objective - Internal Sewer Flooding Risk	0
	Planning Objective - Pollution Risk	1
	Planning Objective - Sewer Collapse Risk	1
		2
	Planning Objective - Storm Overflow performance...8	0
	Planning Objective - Risk of WwTW Compliance Failure...9	1
		2
	Planning Objective - Storm	0

Group	Description	Value
	Overflow performance...11	
	Planning Objective - Risk of WwTW Compliance Failure...12	1

Score/Colour	Definition
0	No significance
1	Moderately Significant
2	Very Significant

Figure 13: BRAVA scoring legend

BRAVA Risks were categorised from 0-2, with 0 being no significant risk identified, 1 for no immediate risk identified (although future risks may exist) and 2 showing that short- to medium-term risks of a significant nature having been recognised through the data analysis.

Bespoke Planning Objectives

In addition to the six common planning objectives identified within the DWMP Framework, South West Water has included three bespoke planning objectives that are tailored to the South West Region.

Problem Characterisation

Building on the outputs of the BRAVA process, South West Water examined the nature and complexity of the problems arising, how these relate to one another and what interventions could be put in place to mitigate them. The Problem Characterisation stage took the results from BRAVA and developed it further, providing insight into the risks around:

- Internal Sewer Flooding
- Pollution, dividing these between category 1 or category 2 & 3
- Sewer Collapse
- Sewer Flooding in a 1 in 50-year storm
- Sewer Flooding in a 1 in 10-year storm
- Storm Overflow performance
- WwTW Compliance Failure, including Dry Weather Flow scenarios

These ratings (shown in Table 21) were augmented with commentary (in Table 22) around how these risks have impacted the Fowey-Looe-Seaton catchment previously, with Flooding Heat Maps providing visual indicators of the scale of some of the potential problems within each catchment.

Table 21: Problem Characterisation

TPU2	F1: Internal sewer flooding	F2: Risk of sewer flooding in a 1 in 10 year event	F3: Risk of sewer flooding in a 1 in 50 year event	P1: Pollution incidents (CAT 1-3)	P2: Severe Pollutions (Cat 1-2)	P3: Storm overflow performance	P4: WwTW (NUMERIC) compliance failure	P5: WwTW (DWF) compliance failure	A1: Sewer collapse
TPU 14: ST CLEER_STW_LISKEARD	F	B	F	A	A	F	G	A	F
TPU 16: POLPERRO FINESCREEN_STW_POLPERRO	F	G	G	G	A	A	A	A	G
TPU 12: SEATON AND DOWNDERRY_STW_SEATON	A	G	G	G	A	F	A	A	A
TPU 2: LODGEHILL_STW_LISKEARD	F	F	G	G	A	A	F	A	F
TPU 13: FOWEY_STW_FOWEY	F	F	G	G	A	F	A	A	G
TPU 9: MINIONS_STW_MINIONS	A	F	F	A	A	A	A		A
TPU 11: LOOE_STW_WEST LOOE	A	G	G	A	A	F	A	A	G

TPU2	F1: Internal sewer flooding	F2: Risk of sewer flooding in a 1 in 10 year event	F3: Risk of sewer flooding in a 1 in 50 year event	P1: Pollution incidents (CAT 1-3)	P2: Severe Pollutions (Cat 1-2)	P3: Storm overflow performance	P4: WwTW (NUMERIC) compliance failure	P5: WwTW (DWF) compliance failure	A1: Sewer collapse
TPU 1: LOSTWITHIEL_STW_L OSTWITHIEL	A	F	G	A	A	F	F	A	G
TPU 3: PELYNT_STW_PELYN T	A	A	A	A	A	G	F	A	A
TPU 4: MENHENIOT_STW_ MENHENIOT	A	A	A	A	A	F	A	A	A
TPU 5: GOLANT_STW_LOST WITHIEL	A	A	A	A	A	G	A	A	A
TPU 6: LERRYN_STW_LOST WITHIEL	A	A	A	A	A	F	A	A	A
TPU 7: EAST TAPHOUSE_STW_EAS T TAPHOUSE	A	A	A	A	A	A	G	A	A
TPU 8: TREWIDLAND_STW_ TREWIDLAND	A	B	B	A	A	A	A		A

TPU2	F1: Internal sewer flooding	F2: Risk of sewer flooding in a 1 in 10 year event	F3: Risk of sewer flooding in a 1 in 50 year event	P1: Pollution incidents (CAT 1-3)	P2: Severe Pollutions (Cat 1-2)	P3: Storm overflow performance	P4: WwTW (NUMERIC) compliance failure	P5: WwTW (DWF) compliance failure	A1: Sewer collapse
TPU 10: LANTEGLOS_STW_LA NTEGLOS	A	A	A	A	A	A	A		A
TPU 15: WIDEGATES_STW_LO OE	A	A	A	A	A	F	A	A	A

RISK PATTERN	Assessment
A	No risks – system is resilient
B	Long term moderate risk
C	Long term high risk
D	Medium term moderate risk
E	Medium term high risk
F	Immediate moderate risk
G	Immediate high risk

Figure 14: Problem Characterisation legend

Table 22: Problem Characterisation Description

TPU	Conclusion Narrative	Historical Pollution and Flooding	Future Flood Risk	Overflows	WwTW
LOSTWITHIEL_STW_L OSTWITHIEL	This catchment requires additional investment to make it resilient for the future.	There is 1 external flooding hotspot attributed to other causes in the catchment, located near; Fore Street	12.5% of the total number of properties within the catchment that are predicted to be at risk of sewer flooding. There are 5 predicted future flooding hotspots in the catchment, located near; Queen Street North Street Grenville Road Trewithan Road Cott Road	There are a total of [No] overflows in the catchment. They have been classified as follows Substandard (High) - 1 - 100% Overflows in this catchment impact on the following bathing beaches/shell fish waters; Fowey SFW	We are monitoring performance at the treatment works and there may be a need to increase capacity as part of a short/medium term strategy.
LODGEHILL_STW_LIS KEARD	This catchment requires additional investment to make it resilient for the future.	There are 5 total internal flooding incidents in the catchment, this is 0.07% of the total number of properties within the catchment There are 5 external flooding hotspots	6.1% of the total number of properties within the catchment that are predicted to be at risk of sewer flooding. There are 7 predicted future flooding hotspots in the	There are a total of 12 overflows in the catchment. They have been classified as follows Satisfactory - 1 - 8% Substandard (Medium) - 2 - 17% Substandard (High) - 1 - 8%	We are monitoring performance at the treatment works and there may be a need to increase capacity as part of a short/medium term strategy.

TPU	Conclusion Narrative	Historical Pollution and Flooding	Future Flood Risk	Overflows	WwTW
		<p>attributed to other causes in the catchment, located near; St Keyne Liskeard Centre Station Road, Liskeard Park View, Liskeard Miners Way, Liskeard</p> <p>There are 3 pollution hotspots in the catchment, located near; Lodgehill STW [169] Oaklands Rad [96] Sungirt Lane [90]</p>	<p>catchment, located near; Dobwalls Russell Street Lanchard Rise Barras Street Pound Street Well Lane Lake Lane</p>	<p>Not Classified - 8 - 67%</p> <p>Overflows in this catchment impact on the following bathing beaches/shell fish waters; East Looe Beach</p>	
PELYNT_STW_PELYN T	<p>This catchment requires additional investment to make it resilient for the future.</p>	<p>There were no substantial flooding or pollution hotspots in the catchment.</p>	<p>NON-MODELLED APPROACH</p>	<p>There are a total of 3 overflows in the catchment. They have been classified as follows Substandard (High) - 2 - 66% Not Classified - 1 - 33%</p>	<p>We are monitoring performance at the treatment works and there may be a need to increase capacity as part of a short/medium term strategy.</p>

TPU	Conclusion Narrative	Historical Pollution and Flooding	Future Flood Risk	Overflows	WwTW
MENHENIOT_STW_ MENHENIOT	This catchment requires additional investment to make it resilient for the future.	There were no substantial flooding or pollution hotspots in the catchment.	NON-MODELLED APPROACH	<p>There are a total of 4 overflows in the catchment. They have been classified as follows</p> <p>Satisfactory - 1 - 25% Substandard (Medium) - 2 - 50% Substandard (High) - 1 - 25%</p> <p>Overflows in this catchment impact on the following bathing beaches/shell fish waters; SEATON BEACH (CORNWALL)</p>	We are monitoring performance at the treatment works and we are not expecting any compliance issues due to lack of capacity between now and 2050.
GOLANT_STW_LOST WITHIEL	This catchment requires additional investment to make it resilient for the future.	There were no substantial flooding or pollution hotspots in the catchment.	NON-MODELLED APPROACH	<p>There are a total of 1 overflows in the catchment. They have been classified as follows</p> <p>Substandard (High) - 1 - 100%</p> <p>Overflows in this catchment impact on the following bathing</p>	We are monitoring performance at the treatment works and we are not expecting any compliance issues due to lack of capacity between now and 2050.

TPU	Conclusion Narrative	Historical Pollution and Flooding	Future Flood Risk	Overflows	WwTW
				beaches/shell fish waters; Fowey SFW	
LERRYN_STW_LOST WITHIEL	This catchment requires additional investment to make it resilient for the future.	There were no substantial flooding or pollution hotspots in the catchment.	NON-MODELLED APPROACH	There are a total of 2 overflows in the catchment. They have been classified as follows Substandard (High) - 1 - 50% Not Classified - 1 - 50%	We are monitoring performance at the treatment works and we are not expecting any compliance issues due to lack of capacity between now and 2050.
EAST TAPHOUSE_STW_EAS T TAPHOUSE	This catchment is performing well and is resilient for the future.	There were no substantial flooding or pollution hotspots in the catchment.	NON-MODELLED APPROACH	There are a total of 1 overflows in the catchment. They have been classified as follows Substandard (Medium) - 1 - 100%	We are monitoring performance at the treatment works and there may be a need to increase capacity as part of a short/medium term strategy.
TREWIDLAND_STW_ TREWIDLAND	This catchment is performing well and is resilient for the future.	There were no substantial flooding or pollution hotspots in the catchment.	NON-MODELLED APPROACH	There are a total of 1 overflows in the catchment. They have been classified as follows Not Classified - 1 - 100%	We are monitoring performance at the treatment works and we are not expecting any compliance issues due to lack of capacity between

TPU	Conclusion Narrative	Historical Pollution and Flooding	Future Flood Risk	Overflows	WwTW
					now and 2050.
MINIONS_STW_MINIONS	This catchment is performing well and is resilient for the future.	There are no external flooding hotspots in the catchment.	NON-MODELLED APPROACH	There are a total of 2 overflows in the catchment. They have been classified as follows Not Classified - 2 - 100%	We are monitoring performance at the treatment works and we are not expecting any compliance issues due to lack of capacity between now and 2050.
LANTEGLOS_STW_LANTEGLOS	This catchment is performing well and is resilient for the future.	There were no substantial flooding or pollution hotspots in the catchment.	NON-MODELLED APPROACH	N/A	We are monitoring performance at the treatment works and we are not expecting any compliance issues due to lack of capacity between now and 2050.
LOOE_STW_WEST LOOE	This catchment requires additional investment to make it resilient for the future.	There is 1 external flooding hotspot attributed to hydraulic overload in the catchment, located near; Shutta There are 3 external flooding hotspots attributed to other	7.9% of the total number of properties within the catchment that are predicted to be at risk of sewer flooding. There are 4 predicted future flooding hotspots in the catchment, located	There are a total of 6 overflows in the catchment. They have been classified as follows Substandard (High) - 5 - 83% Not Classified - 1 - 17% Overflows in this	We are monitoring performance at the treatment works and we are not expecting any compliance issues due to lack of capacity between now and 2050.

TPU	Conclusion Narrative	Historical Pollution and Flooding	Future Flood Risk	Overflows	WwTW
		<p>causes in the catchment, located near;</p> <p>West Looe Hill East Looe Sunrising Estate</p>	<p>near;</p> <p>West Looe East Looe Plaidy Shutta</p>	<p>catchment impact on the following bathing beaches/shell fish waters;</p> <p>EAST LOOE BEACH MILLENDREATH BEACH</p>	
SEATON AND DOWNDERRY_STW_S EATON	<p>This catchment requires additional investment to make it resilient for the future.</p>	<p>There are 2 external flooding hotspots attributed to hydraulic overload in the catchment, located near;</p> <p>East Seaton Downderry</p> <p>There are 2 external flooding hotspots attributed to other causes in the catchment, located near;</p> <p>East Seaton Downderry</p> <p>There are 2 pollution hotspots in the catchment, located near;</p>	<p>NON-MODELLED APPROACH</p>	<p>There are a total of 2 overflows in the catchment. They have been classified as follows</p> <p>Substandard (Medium) - 1 - 50% Substandard (High) - 1 - 50%</p> <p>Overflows in this catchment impact on the following bathing beaches/shell fish waters;</p> <p>DOWNDERRY BEACH SEATON BEACH (CORNWALL)</p>	<p>We are monitoring performance at the treatment works and we are not expecting any compliance issues due to lack of capacity between now and 2050.</p>

TPU	Conclusion Narrative	Historical Pollution and Flooding	Future Flood Risk	Overflows	WwTW
		Seaton and Donderry STW [188] Seaton SPST [100]			
FOWEY_STW_FOWEY	This catchment requires additional investment to make it resilient for the future.	<p>There are 5 total internal flooding incidents in the catchment, this is 0.21% of the total number of properties within the catchment</p> <p>There is 1 external flooding hotspot attributed to hydraulic overload in the catchment, located near; Town Quay SPS</p> <p>There are 3 external flooding hotspots attributed to other causes in the catchment, located near; Greenbank, Polruan Town Quay SPS The Quay SPS</p>	<p>7.6% of the total number of properties within the catchment that are predicted to be at risk of sewer flooding.</p> <p>There are 3 predicted future flooding hotspots in the catchment, located near; Fore Street Browns Hill Polruan</p>	<p>There are a total of 8 overflows in the catchment. They have been classified as follows</p> <p>Satisfactory - 2 - 25% Substandard (Medium) - 3 - 38% Substandard (High) - 2 - 25% Unsatisfactory - 1 - 13%</p> <p>Overflows in this catchment impact on the following bathing beaches/shell fish waters; READYMONEY COVE Fowey SFW</p>	We are monitoring performance at the treatment works and we are not expecting any compliance issues due to lack of capacity between now and 2050.

TPU	Conclusion Narrative	Historical Pollution and Flooding	Future Flood Risk	Overflows	WwTW
		There are 2 pollution hotspots in the catchment, located near; Ferryside [142] Town Quay SPS [13]			
ST CLEER_STW_LISKEARD	This catchment requires additional investment to make it resilient for the future.	There are 1 total internal flooding incidents in the catchment, this is 0.08% of the total number of properties within the catchment There are 3 external flooding hotspots attributed to other causes in the catchment, located near; Fore Street, St Cleer Tremar Coombe Tremar	3.7% of the total number of properties within the catchment that are predicted to be at risk of sewer flooding. There are 3 predicted future flooding hotspots in the catchment, located near; Well Lane, St Cleer Tremar Coombe Lower Tremar	There are a total of 1 overflows in the catchment. They have been classified as follows Substandard (High) - 1 - 100%	We are monitoring performance at the treatment works and there may be a need to increase capacity as part of a short/medium term strategy.
WIDEGATES_STW_LOOE	This catchment requires additional investment to make it resilient for the	There were no substantial flooding or pollution hotspots in the catchment.	N/A	There are a total of 1 overflows in the catchment. They have been classified	We are monitoring performance at the treatment works and we are not expecting

TPU	Conclusion Narrative	Historical Pollution and Flooding	Future Flood Risk	Overflows	WwTW
	future.			as follows Substandard (High) - 1 - 100%	any compliance issues due to lack of capacity between now and 2050.
POLPERRO FINESCREEN_STW_P OLPERRO	This catchment requires additional investment to make it resilient for the future.	<p>There are 1 total internal flooding incidents in the catchment, this is 0.09% of the total number of properties within the catchment</p> <p>There is 1 external flooding hotspot attributed to hydraulic overload in the catchment, located near; Mill Hill</p> <p>There are 3 external flooding hotspots attributed to other causes in the catchment, located near; Polperro Quay The Warren Mill Hill</p>	<p>13.2% of the total number of properties within the catchment that are predicted to be at risk of sewer flooding.</p> <p>There are 2 predicted future flooding hotspots in the catchment, located near; Fore Street, Polperro Crumplehorn</p>	There are a total of 1 overflows in the catchment. They have been classified as follows Substandard (Medium) - 1 - 100%	We are monitoring performance at the treatment works and we are not expecting any compliance issues due to lack of capacity between now and 2050.

TPU	Conclusion Narrative	Historical Pollution and Flooding	Future Flood Risk	Overflows	WwTW
		<p>There are 3 pollution hotspots in the catchment, located near;</p> <ul style="list-style-type: none"> Greville Walk [42] Polperro Catchment [1] Polperro STW [191] 			

Resilience Assessment

Resilience is a statutory duty for Ofwat under the 2014 Water Industry Act, but more importantly for us it is the philosophy that allows us to consider how we best manage our services to customers in a changing and sometime challenging environment. Such challenges encompass a wide range of factors such as extreme weather conditions; drought and flooding; land use and catchment pressures; power supply and communications reliability; skills and organisational capacity; supply chain capability; as well as changing environmental and public health challenges to meet the needs of consumers now as well as in the longer term. The details below form part of the Operational Resilience assessment within the DWMP. Namely:

- Coastal Flood Inundation
- Coastal Erosion
- Fluvial Flooding (Response and Recovery Plans)
- Power Outage
- Operational Telemetry (OT)

Coastal flooding and Erosion

UK coastal flood and erosion risk is expected to increase over the 21st century due to the impact in sea level rise and climate change. Which means that we can expect to see both an increase in the frequency and magnitude of extreme water levels and weather events around the UK coastline. This is particularly significant for the SW region due to the extensive coastline and numerous coastal communities who rely on the safe and constant provision of clean and wastewater services. The South West's tourism economy is also dependent, to a large extent, on the extensive coastline, acknowledged by EA through improvements to coastal waters over decades of investment under the Bathing Water drivers. As a consequence, an assessment of the risks associated with present day and future projected coastal flood and erosion risk was undertaken utilising the latest available science.

Coastal Flooding

Coastal flood risk was modelled for three climate scenarios, the first representing present-day risk in 2022 and second, the future climate change scenarios (RCP2.5 and RCP8.6) representing the projected risk in 2035 and 2050. To fully assess future risk for each of the above climate change scenarios four return events were evaluated, these were:

- Highest Astronomical Tide (HAT) event - represents the maximum observed tide under average atmospheric conditions
- 1 in 5-year storm return period event - a high probability event with a 20% chance of happening in any one year
- 1 in 50-year storm return period event – a moderate probability event with a 2% chance of occurring in any one year
- 1 in 200-year storm return period event – a low probability event with a 0.5% chance of occurring in any one year The EA Coastal Flood Boundary data for the assessment of extreme sea level rise was also used

A total of 653¹ Sewage Treatment Works (STW), 1235 Sewage Pumping Stations (SPS) plus the associated wastewater infrastructure were assessed for coastal flood risk. Sites have been assessed based upon a number of different storm and flood scenarios considering the risks to the site, the defence of the site and wider EA flood defence work. The 1 in 200-year flood extent for the three time periods is indicated in Figure 15 below.

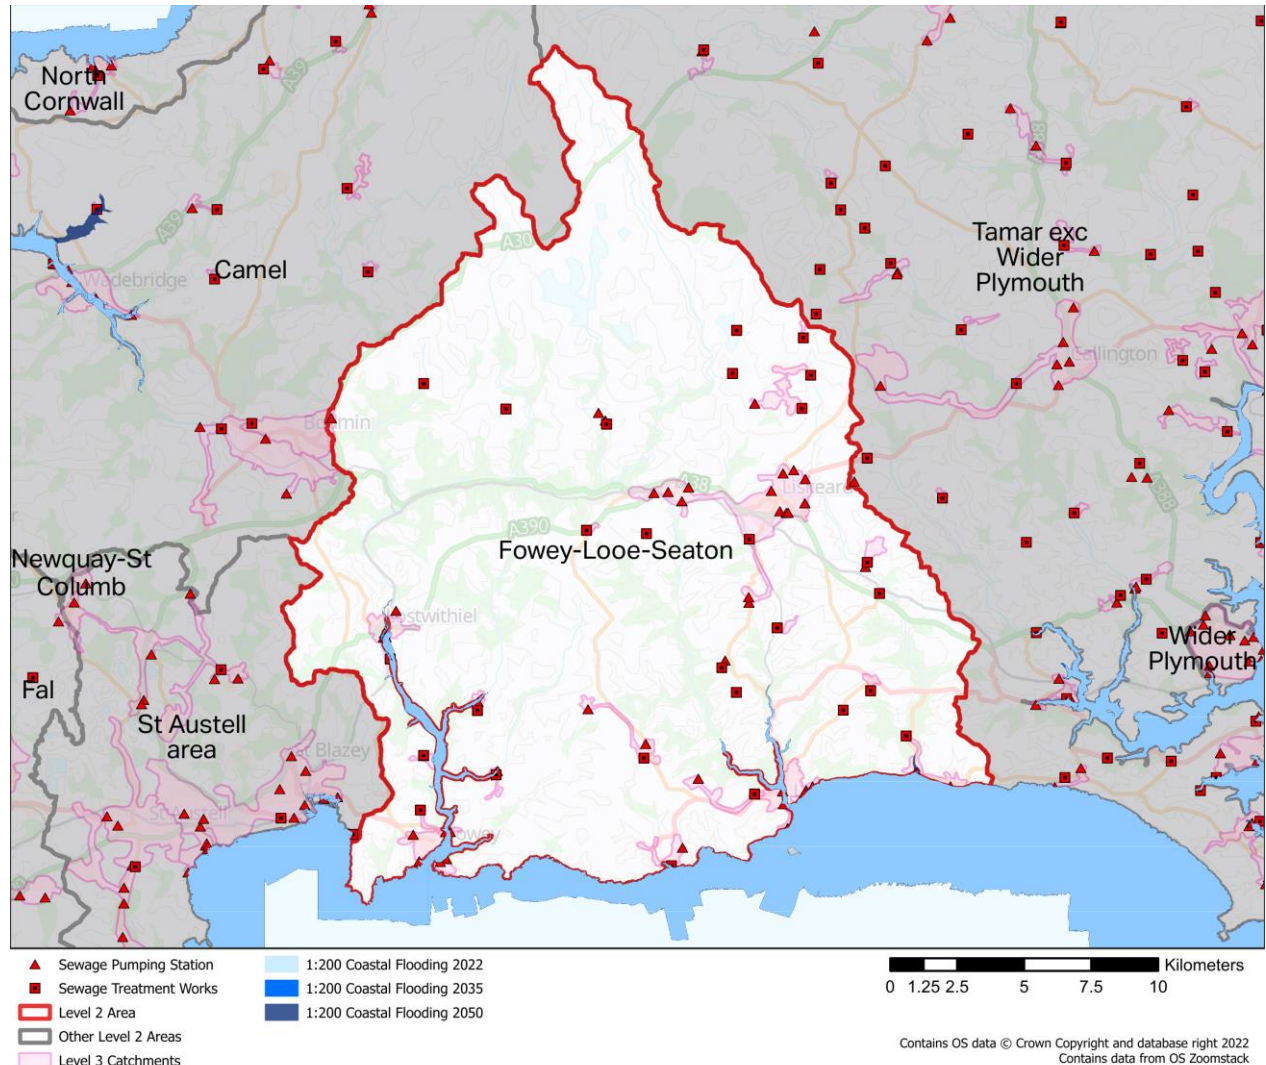


Figure 15: Extent of coastal flooding

Possible interventions to manage the risks have been identified as the provision of flood defences for the site, either as a SWW deliverable or as part of a wider programme of coastal defences working with EA and other RMAs. Thereby delivering greater benefit for coastal communities. An alternative intervention is to relocate the asset to a more secure location ensuring ability to continue to service local communities. This option is more likely to be part of a wider decision to relocate communities at risk and would be taken in close collaboration with the EA and responsible RMAs. The sewer infrastructure identified at risk

¹ Catchments are being continually reviewed as part of other workstreams and may be subject to change, Power Outage and OT defined in 'Our Regional Plan'

is associated with the hydrodynamic modelling outputs. This provides additional assurance for the network assessed as being at risk.

Coastal Erosion

A hazard assessment of coastal erosion susceptibility was undertaken with the aim of better understanding the risk posed to SWW assets and provide information whereby asset investment can be effectively prioritised allowing for a more targeted approach for future allocation of operational and capital expenditure. A detailed assessment of coastal erosion risk was assessed for all of our operational wastewater sites (653 STW's and co-located Sludge Treatment Centre [STC], 1235 SPS's plus associated infrastructure). All sites were only at risk from erosion and not from coastal flooding.

The assessment combines two approaches:

- A high-level screening to identify sites at coastal erosion risk by 2118
- A detailed site-by-site erosion analysis for the three epochs: 2022, 2035, and 2050

The high-level coastal erosion risk assessment is based on the NCERM (National Coastal Erosion Risk Mapping) dataset. The erosion risk was calculated based on the distance of the asset from the projected cliff edge with a geological scaling factor applied based on the erodibility of the underlying geology. Each site identified at risk had detailed erosion analysis undertaken. This included site-specific conditions that influence the rate of coastal erosion, such as geology, for the three time frames 2022, 2035, and 2050. This produced a ranked output highlighting assets at greatest risk of coastal erosion. The extent of coastal erosion in 2035 and 2050 is indicated in Figure 16 below.

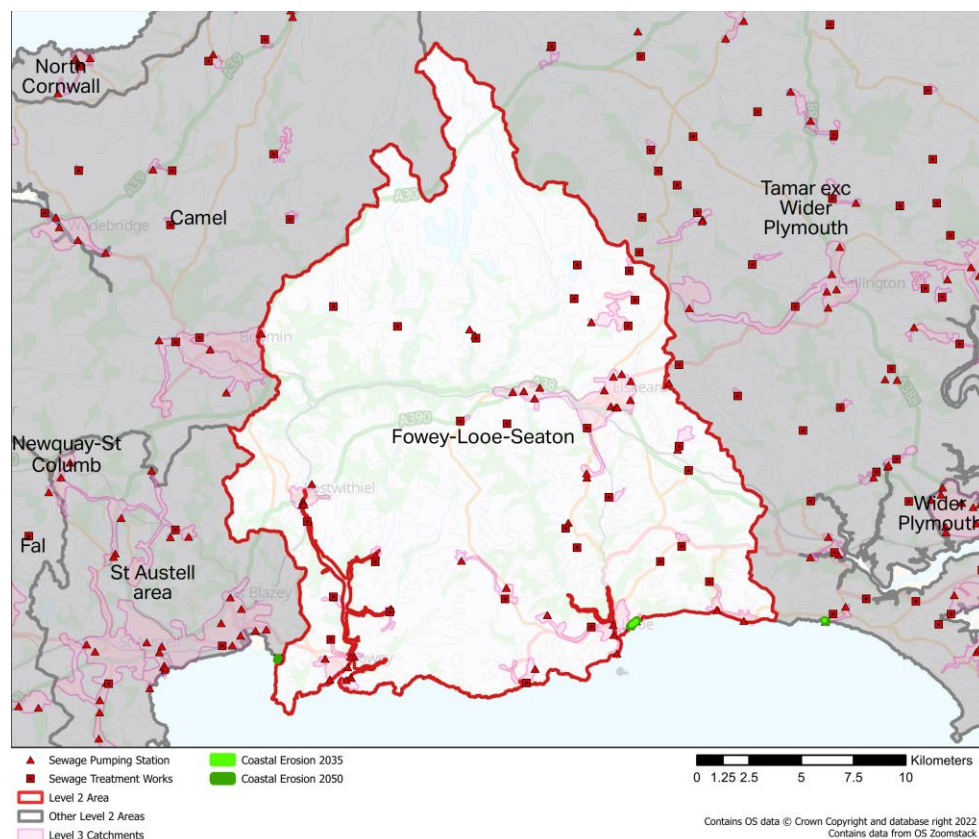


Figure 16: Extent of coastal erosion in 2035 and 2050

The EA have been allocated £2.5m capital funding to work with partners to deliver an update to the NCERM, across England by the end of 2023. The update to NCERM complements the dependent project to refresh the 20 Shoreline Management Plans (SMPs) across England, and other similar EA/DEFRA projects seeking to update flood and coastal erosion risk mapping, modelling and assessment. Combined, all of this activity will provide an essential body of data and evidence to underpin future adaptation and planning investment decisions of relevant coastal RMAs. This being the case the current strategy is to continue to evaluate the risks through AMP8 following the publication of the revised NCERM, working alongside other external agencies and key stakeholders including the relevant coastal risk management authorities to determine the level of risk, relevant SMP policy and therefore any subsequent required investment to mitigate coastal erosion impact.

Fluvial and Pluvial Flooding

UK fluvial flood risk is expected to increase over the 21st century which means that we can expect to see both an increase in the frequency and magnitude of extreme water levels around the UK. As a consequence, an assessment of the risks associated with future fluvial flooding due to projected climate change has been evaluated using the latest available science, UKCP18. The UKCP (United Kingdom Climate Projections) is a suite of climate models developed by the UK Met Office (Meteorological Office) and the Centre for Ecology & Hydrology to provide projections of future climate change in the United Kingdom. The UKCP models use data from global climate models to provide regional and local-scale projections of temperature, precipitation, and other climate variables over the coming decades. The UKCP models have been used to inform policy and decision-making in the UK on issues related to climate change adaptation and mitigation. The UKCP model projections are based on scenarios of future greenhouse gas emissions and consider the most up-to-date scientific understanding of the physical processes that drive the climate system. A total of 653 STW's, 1235 SPS's plus the associated wastewater infrastructure were assessed.

There was a phase 1 screening to identify sites at risk and a high-level screening exercise was undertaken against existing known flood zone extents. This utilised EA flood zone data sets and Defra surface water flooding data sets. A further step was taken in refining the fluvial flood zone data to exclude coastal flooding from the dataset as this risk was appraised separately as part of a Coastal Flood Risk Assessment.

Following a review of outputs from Phase 1 the assessment of sites identified at risk are taken forward to a Phase 2 assessment. The detailed assessment includes both present day risk and two climate change scenarios (RCP2.6 and 8.5) to understand the changes in flood risk over time. The assessment considers both the area flooded and a range of modelled flood depth statistics. These enhanced flood metrics can then be combined with asset information and external factors to develop a more detailed assessment of the risk to each shortlisted asset. For these sites detailed Flood Assessment Reports (FARs) are produced. These reports are designed to be used as a preliminary form of flood risk assessment identifying the potential flood risk for a specified location.

Option Development and Appraisal

Future WINEP Investment

Earlier this year, we presented our WINEP investment programme for 2025 onwards to the EA. Our programme includes substantial investment to improve and protect the environment from our drainage and wastewater activities. The plan focuses on the period between 2025-2030 but also considers our, and the government's, longer term strategy for environmental improvements over the next 25 years. The wastewater investments included in the WINEP for 2025 to 2030 include:

- Investigating and reducing storm overflow discharges
- Investigating and improving bathing water and shellfish water quality, usually through a reduction in storm overflow discharges
- Investigating and protecting high priority sites such as SSSIs and SACs that are impacted by our drainage and wastewater treatment activities
- Investigating and reducing the impact of nutrients and chemicals from our WwTW discharges, especially Phosphorus, usually by increasing treatment capacity to meet more stringent permit levels
- Investments at WwTWs to meet more stringent requirements under the Urban Waste Water Treatment (England and Wales) Regulations 1994, driven by population growth and to provide increased treatment capacity at septic tanks
- Increased monitoring at WwTWs, SPSs, emergency overflows, and in rivers close to our storm overflow discharge points
- Investment in bio-resources
- Investigations into future potential improvements in the treatment of nitrogen and microplastics

In all cases, we have reviewed a number of different options for each investment and have taken into account the wider environmental and societal benefits, including impacts on embodied and operational carbon. We also spoke to our customers about the types of investments, as well as solutions, that they would prefer to see in our plan. All of this, combined with a long-term 30-year view of Total Expenditure (Totex) expenditure allowed us to present a preferred option to the EA for assessment. The investments in the WINEP programme have been produced in alignment with our DWMP. The final WINEP programme is expected to be agreed in July 2023 and hence is not presented here in detail.

ODA Prioritisation

The RBCS and BRAVA steps identified the Level 3 TPUs that were likely to need interventions to mitigate future risk. The PC step then assessed the severity and timing of these risks from 2020 to 2050. To further prioritise ODA effort and future interventions, ODA performance thresholds were applied to all TPUs as follows:

- Collapse Risk – < 10 collapses
- Pollution & Flooding Risk – incidents < 0.1% catchment total, external issues, hydraulic issues, hotspots present
- Future Flood Risk (FFR) – < 5% properties at risk of internal flooding in a 1 in 50 event

- Storm Overflow (SO) Risk – < 10 spills from any SO
- WWTW Compliance – Best judgement

Where no thresholds were met, risk was considered low and TPUs did not proceed to ODA. Performance will continue to be monitored through the DWMP process.

The TPUs that proceeded to ODA were then classed as Standard, Extended or Complex based on the total risk score and quality of hydraulic models, to determine our ODA approach taken in ODA. Standard TPUs are small (average population 756) with simpler problems and more straightforward interventions. Extended TPUs are larger (average population 9,553), have more risks and more complicated solutions. Complex TPUs are the largest (average population 23,132) with more complex systems and solutions, but better hydraulic models.

Table 23: Level 3 TPUs - Progression through DWMP stages and ODA class

TPU	RBCS	BRAVA	ODA	TPU Class
EAST TAPHOUSE_STW_EAST TAPHOUSE	YES	YES	YES	Standard
FOWEY_STW_FOWEY	YES	YES	YES	Extended
GOLANT_STW_LOSTWITHIEL	YES	YES	NO	N/A
LANTEGLOS_STW_LANTEGLOS	YES	YES	NO	N/A
LERRYN_STW_LOSTWITHIEL	YES	YES	NO	N/A
LODGEHILL_STW_LISKEARD	YES	YES	YES	Complex
LOOE_STW_WEST LOOE	YES	YES	YES	Complex
LOSTWITHIEL_STW_LOSTWITHIEL	YES	YES	YES	Complex
MENHENIOT_STW_MENHENIOT	YES	YES	NO	N/A
MINIONS_STW_MINIONS	YES	YES	NO	N/A
PELYNT_STW_PELYNT	YES	YES	YES	Standard
POLPERRO FINESCREEN_STW_POLPERRO	YES	YES	YES	Complex
SEATON AND DOWNDERRY_STW_SEATON	YES	YES	YES	Extended
ST CLEER_STW_LISKEARD	YES	YES	YES	Extended
TREWIDLAND_STW_TREWIDLAND	YES	YES	NO	N/A
WIDEGATES_STW_LOOE	YES	YES	NO	N/A
CARDINHAM_STW_CARDINHAM	YES	NO	NO	N/A

TPU	RBCS	BRAVA	ODA	TPU Class
COMMON MOOR_STW_COMMON MOOR	YES	NO	NO	N/A
CROWS NEST_STW_DARITE	YES	NO	NO	N/A
DULOE_STW_DULOE	YES	NO	NO	N/A
HOLLAND ROAD RBC_STW_NO MANS LAND	YES	NO	NO	N/A
MOUNT_STW_MOUNT	YES	NO	NO	N/A
SIBLYBACK LAKE_SEPTNK_SIBLYBACK	YES	NO	NO	N/A
ST NEOT_STW_ST NEOT	YES	NO	NO	N/A
STATION ROAD_STW_MENHENIOT	YES	NO	NO	N/A
TREDINNICK_STW_TREDINNICK	YES	NO	NO	N/A
TREVELMOND_STW_DOBWALLS	YES	NO	NO	N/A

Of the 27 TPUs in the Fowey-Looe-Seaton catchment, 16 proceeded through RBCS to BRAVA (the 11 remaining catchments had 1 or no indicators breached, and if 1 indicator was breached it was not tier 1) and 9 proceeded to ODA. Of these, 2 were classed as Standard, 3 Extended and 4 Complex.

Intervention Selection and Assessment

Catchment area teams reviewed each TPU and assigned up to 3 interventions to address the specific catchment risks from the standard list in the DWMP guidance (Table 24 below).

Table 24: Generic Interventions

Management Area/Option Type	Description	Generic option examples- Standard TPU's	Sub-option examples- Extended & Complex TPU's	Option ID
Customer side management options	Generic options to manage the use of water in and arising from customer properties	Water efficient appliances	Promote and make available water efficient appliances to reduce production of domestic wastewater	CE1
		Rainwater harvesting	Promote and make available rainwater harvesting systems	CE2
		Customer incentives	Promotion of incentives to reduce impermeable areas	CE3
		Domestic and business customer education (Targeted Customer Behaviours)	Love Your Loo, etc. Likely focus at L1; however, where location specific issues are identified activities could be targeted around what should and shouldn't be put down sewers	CE4
Surface water management - Pollution & Flooding, Overflows	Generic options within catchments to manage surface water flows entering the conveyance system	Surface water source control measures	Company installation of source control sustainable drainage systems (SuDS)	SWM1
		Surface water source control measures	SuDS partnerships with key stakeholders	SWM2
		Surface water source control measures	Upper Catchment Solution/Upstream Thinking	SWM3
		Surface water pathway measures	Separate surface water from combined systems by constructing new surface water networks (and/or	SWM4

Management Area/Option Type	Description	Generic option examples- Standard TPU's	Sub-option examples- Extended & Complex TPU's	Option ID
			modify existing)	
		Surface water pathway measures	Integrate surface water pathway measures into new and upgraded third party designs	SWM5
		Surface water infiltration measures	Develop a program to reduce Surface Water Infiltration	SWM6
Combined and foul sewer systems - Overflows, Pollution & Flooding Collapses	Generic options to manage flows within the conveyance system to minimise impacts on customers and the environment	Intelligent network operation	Implement widespread sewer/pumping station level monitoring, live network modelling linked to operational responses such as proactive jetting	CFS1
		Increase the capacity of existing foul/combined networks	Construct new stormwater storage systems	CFS2
		Increase the capacity of existing foul/combined networks	Replace or upgrade existing networks	CFS3
		Wastewater transfers	Inter-catchment network transfers	CFS4
		Wastewater transfers	inter-catchment WwTW transfers	CFS5
Wastewater treatment	Generic options to manage flows and loads at wastewater treatment works to minimise impacts on customers and the environment	Treat or pre-treat wastewater in the network	Treat or pre-treat flows at existing pumping stations or within sewer network	WWT1
		Increase treatment capacity	Upgrade existing works using more intensive processes	WWT2

Management Area/Option Type	Description	Generic option examples- Standard TPU's	Sub-option examples- Extended & Complex TPU's	Option ID
		Increase treatment capacity	Add additional process streams (increase plant capacity)	WWT3
		Treatment works rationalisation/ decentralisation	Replace existing treatment works with one large scale installation	WWT4
		Treatment works rationalisation/ decentralisation	Replace existing treatment works with several smaller scale installations	WWT5
		Modify consents and permits	Catchment consenting	WWT7
		Modify consents and permits	Adaptive consenting (e.g. "wet weather" relaxation)	WWT8
		Catchment management initiatives	Initiatives to address fertiliser use and application	WWT9

These initial selections were then subject the following checks and reviews:

- Internal review by Catchment Managers (all) and WwTW experts (WwTW)
- External review by key stakeholders (all)
- Internal hydraulic modelling of selected catchments and extrapolation of modelling results to non-modelled catchments (FFR and SO risk)
- Internal review of the above by DWMP team

Intervention Quantification and Costing

Preferred interventions were quantified using modelling and extrapolation. Up to 5 final interventions were selected, reflecting the need for a combination of solutions. Costs were provided by South West Water's cost consultants, using approved cost models based on South West Water data where possible, and from past South West Water scheme data or industry recognised estimates if not.

The approach was different for different risks:

Collapses – Quantification and costing not included in DWMP. Risks and interventions noted but plan already covered by wider programme of sewer rehabilitation and repairs.

Pollution & Flooding – Quantification and costing included in DWMP only where an enhancement over and above existing programmes of work were recommended.

Future Flood Risk (FFR) – 26 Complex catchments were hydraulically modelled to assess options to address risk. The results were used to extrapolate to non-modelled catchments. It was assumed at the outset that Nature Based solutions such as Sustainable drainage systems (SuDS) were a possibility wherever surface water separation (SWS) was suggested. Suitability of SuDS for surface water separation assessed at high level using Stantec's GIS based Surface Water Assessment Tool (SWAT) analysis.

Storm Overflows (SO) - 12 catchments (8 complex 4 extended) were selected for hydraulic modelling to give coverage of 233 SOs (c.20% of South West Water total) and a representative sample of receiving waters. Results were used to extrapolate to non-modelled DWMP TPUs. To meet the later DEFRA SO guidance, a separate top-down desktop model based on Event Duration Monitor (EDM) spill data was developed to assess total need for all TPUs.

WWTW Performance – Analyses of Biological Oxygen Demand (BOD) Capacity and DWF permit compared with future population and flow projections were used to assess sites at future risk of meeting permit requirements. The scale of upgrades needed was estimated using a calculation of the increase in population equivalent PE or additional capacity in cubic metres required at the works.

Results - Interventions

Table 25 below outlines the final interventions selected for the TPUs in the Fowey-Looe-Seaton catchment, along with potential solutions involving partnership working or nature-based solutions. The intervention codes applied are defined in Table 24 above.

Table 25: TPU interventions selection and feedback

TPU	Class	Nature based solutions assessment Comments	Partnership working potential Comments	Final #1	Final #2	Final #3	Final #4	Final #5	Final DWMP ODA assessment summary
EAST TAPHOUSE_ST W_EAST TAPHOUSE	Standard	SWW: Assume no potential unless advised by WWTW team	SWW: Assume no potential	CFS2	SWM4	SWM6	WWT3		WWT3 Wastewater treatment and Surface water management intervention SWM6 carried over. Combined and foul sewer systems CFS2 and Surface water management intervention SWM4 added. WWT2 Wastewater treatment removed.
FOWEY_STW_ FOWEY	Extended	SWW: Unlikely	SWW: SUDS ruled out due	CFS2	SWM4				Combined and foul sewer

TPU	Class	Nature based solutions assessment Comments	Partnership working potential Comments	Final #1	Final #2	Final #3	Final #4	Final #5	Final DWMP ODA assessment summary
		suitable for SUDS as steep, narrow roads	to catchment characteristics						systems CFS2, Surface water management intervention SWM4 carried over. Surface water management intervention SWM6 removed.
LODGEHILL_STW_LISKEARD	Complex	SWW: Potential SUDS for SW separation	SWW: Potential SUDS	CFS2	SWM4	SWM6	WWT3		Surface Water management SWM4, SWM6 and Wastewater treatment WWT3 carried over. Combined and foul sewer systems CFS2 added in.
LOOE_STW_WEST LOOE	Complex	SWW: Potential SUDS for SW separation identified	SWW: Potential SUDS identified	CFS2	SWM4	SWM6	WWT3		Surface Water management SWM4 and SWM6, Combined and

TPU	Class	Nature based solutions assessment Comments	Partnership working potential Comments	Final #1	Final #2	Final #3	Final #4	Final #5	Final DWMP ODA assessment summary
									foul sewer systems CSF2 carried over . Surface Water management SWM1 removed. Wastewater treatment WWT3 added in.
LOSTWITHIEL_STW_LOSTWIT_HIEL	Complex	SWW: Potential SUDS for SW separation	SWW: Potential SUDS	SWM6	WWT3				Surface Water management SWM6 and Wastewater treatment WWT3 carried over. Surface Water management SWM4 and Combined and foul sewer systems CSF2 removed.
PELYNT_STW_PELYNT	Standard	SWW: Potential SUDS for SW	SWW: Potential SUDS	CFS2	SWM4	SWM6	WWT3		Wastewater treatment intervention

TPU	Class	Nature based solutions assessment Comments	Partnership working potential Comments	Final #1	Final #2	Final #3	Final #4	Final #5	Final DWMP ODA assessment summary
		separation							WWT2 removed but WWT3 carried over with SWM4, SWM6 and CSF2
POLPERRO FINESCREEN_STW_POLPERRO	Complex	SWW: Potential SUDS for SW separation	SWW: Potential SUDS, conventional SWS more suited	SWM6					Combined and foul sewer systems CFS2 and Surface water management SWM4 removed. Surface water management SWM6 was retained
SEATON & DOWNDERRY_STW_SEATON	Extended	SWW: Potential SUDS for SW separation	SWW: Potential SUDS	CFS2	SWM4	WWT3			Surface water management SWM4 retained with CFS2. SWM6 removed. Wastewater treatment intervention WWT3 added.

TPU	Class	Nature based solutions assessment Comments	Partnership working potential Comments	Final #1	Final #2	Final #3	Final #4	Final #5	Final DWMP ODA assessment summary
ST CLEER_STW_LI SKEARD	Extended	SWW: Potential SUDS for SW separation	SWW: Potential SUDS	CFS2	SWM4	SWM6	WWT3		Combined and foul sewer systems CFS1 removed. Wastewater treatment intervention WWT3 and Surface water management SWM4 and SWM6 and CFS2 carried over

For the Fowey-Looe-Seaton catchment, 9 TPUs progressed to ODA. Stakeholder feedback was received on 6 TPUs. The feedback was mainly on the need to:

- Consult the EA and partners on potential Surface Water Separation (SWS) plans
- Consider links to surface water, fluvial and sea flooding, planned schemes
- Consider coastal erosion risk

Potential Nature Based Solutions were identified for 12 catchments (largely SuDS for Surface Water Separation) and partnership opportunities were identified for 12 catchments (largely on SWS/SuDS).

Table 26 below summarises the final interventions selected now that the ODA stage is complete.

Table 26: Initial and Final Interventions selected by intervention type

INTERVENTION	Total selected Final
CE1: Promote and make available water efficient appliances to reduce production of domestic wastewater	0
CE2: Promote and make available rainwater harvesting systems	0
CE3: Promotion of incentives to reduce impermeable areas	0
CE4: Love Your Loo, etc	0
SWM1: Company installation of source control sustainable drainage systems (SuDS)	0
SWM2: SuDS partnerships with key stakeholders	0
SWM3: Upper Catchment Solution/Up Stream Thinking	0
SWM4: Separate surface water from combined systems by constructing new surface water networks (and/or modify existing)	7
SWM5: Integrate surface water pathway measures into new and upgraded third party designs	0
SWM6: Develop a program to reduce infiltration	7
CFS1: Implement widespread sewer/pumping station level monitoring, live; network modelling linked to operational responses such as proactive jetting	0
CFS2: Construct new combined or foul storage systems	7
CFS3: Replace or upgrade existing networks	0
CFS4: Inter-catchment network transfers	0
CFS5: inter-catchment WwTW's transfers	0

INTERVENTION	Total selected Final
WWT1: Treat or pre-treat flows at existing pumping stations or within sewer network	0
WWT2: Upgrade existing works using more intensive processes	0
WWT3: Add additional process streams (increase plant capacity)	7
WWT4: Replace existing treatment works with one large scale installation	0
WWT5: Replace existing treatment works with several smaller scale installations	0
WWT7: Catchment consenting	0
WWT8: Adaptive consenting (e.g. "wet weather" relaxation)	0
WWT9: Initiatives to address fertiliser use and application	0
Total	28

There were no interventions selected in the Fowey-Looe-Seaton catchment for customer education, although education to promote water efficiency, rainwater harvesting, reducing impermeable areas and preventing sewer misuse will be delivered across the region as part of a company-wide initiative. There were no interventions selected for CFS1 monitoring to direct proactive jetting effort to manage flooding and pollution incidents due to blockages.

Construction of storage systems (CFS2) was recommended based on the results of modelling for storm overflow risk and the preferred solution being a combination of surface water separation and storage.

Where a strategic network or treatment intervention was selected (CFS4,5 WWT4,5) the selection was noted but not progressed under DWMP. These strategic decisions will lead to bespoke plans which will be revisited for PR24 and captured separately in the programme.

The ODA process led to a lot more Surface Water Management (SWM) interventions being selected. Infiltration (SWM6) was selected in all catchments, with the view that this would be the first task to help understand flows and identify opportunities for Surface Water Separation (SWM4), SuDS (SWM1,2) and other nature-based solutions such as Upstream Thinking and Natural Flood Management (SWM3). Our assumption is that unless specifically ruled out, Nature Based solutions such as SuDS will be possible, so they will be explored wherever surface water separation was selected.

Results – Quantities

Table 27 below outlines the quantities of interventions proposed by the DWMP for the Fowey-Looe-Seaton catchment.

Table 27: Quantities for proposed interventions

TPU	Storage (m3)	SWS (ha)	Network Enhancement (km)	No. WWTW for Capacity increase	No. WWTW for DWF increase	No. WWTW for Nutrient reduction
CARDINHAM_STW_CARDINHAM	0	0.00	0.00	0	0	0
COMMON MOOR_STW_COMMON MOOR	0	0.00	0.00	0	0	0
CROWS NEST_STW_DARITE	0	0.00	0.38	0	0	0
DULOE_STW_DULOE	0	0.00	0.00	0	0	1
EAST TAPHOUSE_STW_EAST TAPHOUSE	47	0.79	0.90	1	1	0
FOWEY_STW_FOWEY	10,182	18.60	0.00	0	0	0
GOLANT_STW_LOSTWITHIEL	379	4.37	1.80	0	1	0
LANTEGLOS_STW_LANTEGLOS	0	0.00	1.61	0	0	0
LERRYNT_STW_LOSTWITHIEL	0	0.00	7.75	0	0	0
LODGEHILL_STW_LISKEARD	1,574	9.81	53.30	1	0	1
LOOE_STW_WEST LOOE	10,195	17.80	52.93	0	1	0
LOSTWITHIEL_STW_LOSTWITHIEL	0	0.00	11.20	1	1	0
MENHENIOT_STW_MENHENIOT	0	0.00	0.00	0	0	1
MINIONS_STW_MINIONS	0	0.00	0.00	0	0	0
MOUNT_STW_MOUNT	0	0.00	0.00	0	0	0
PELYNT_STW_PELYNT	3,284	4.96	7.91	1	0	1
POLPERRO FINESCREEN_STW_POLPERRO	0	0.00	5.68	0	0	0
SEATON AND DOWNDERRY_STW_SEATON	861	4.50	0.00	0	0	1
SIBLYBACK	0	0.00	0.00	0	0	0

TPU	Storage (m3)	SWS (ha)	Network Enhancement (km)	No. WWTW for Capacity increase	No. WWTW for DWF increase	No. WWTW for Nutrient reduction
LAKE_SEPTNK_SIBLYBACK						
ST CLEER_STW_LISKEARD	1,288	4.04	12.14	1	1	1
ST NEOT_STW_ST NEOT	0	0.00	0.00	0	0	1
STATION ROAD_STW_MENHENIOT	0	0.00	0.00	0	0	0
TREDINNICK_STW_TREDINNICK	0	0.00	0.00	0	0	0
TREVELMOND_STW_DOBWALLS	0	0.00	0.00	0	0	0
TREWIDLAND_STW_TREWIDLAND	0	0.00	0.00	0	0	0
WIDEGATES_STW_LOOE	93	1.46	1.11	0	0	0

Our proposals for the Fowey-Looe-Seaton catchment include approximately 66ha of SWS by conventional or SUDS solutions, 27,902m³ of storage, 156km of network enhancement, work to improve DWF compliance at 5 treatment sites, upgrading of capacity at 5 treatment sites and work to reduce nutrients at 7 treatment sites.²

Surface Water Separation and SuDS Assessment

To explore opportunities for SWS and SuDS, Stantec's GIS based Surface Water Assessment Tool (SWAT) was applied to the 26 Complex TPUs that were hydraulically modelled for future flood risk (FFR). The tool plots impermeable area, green space, existing networks, buildings, roads and watercourses. It plots existing foul combined and surface water networks and identifies where surface water sewers join combined sewers as potential points for disconnection. It identifies potential land and road space as well as residential and commercial properties for different interventions. Appendix F outlines the approach.

The high-level results indicate that on average it is estimated that SuDS might be suitable for delivering approximately 55% of the SWS required to mitigate the future flood risk in modelled catchments. This ranged from 0% where there was limited space, impermeable land, and no water courses present to discharge to, to 100% in some TPUs. We intend to develop the tool and process in more detail in the future as we progress the first DWMP interventions through feasibility.

² Please note that these are high level strategic planning proposals and do not represent a commitment. The plans and overall programme need to be assessed against other risks and against the wider South West Water programme for risk and affordability.

Upstream Thinking and Natural Flood Management

Appendix G shows the coverage of current UST projects in the SWW region where upper catchment solutions are being successfully explored and the intention is to expand this approach. South West Water's infiltration and site surveys may identify opportunities for Natural Flood Management and Upstream Thinking interventions in the Fowey-Looe-Seaton catchment. South West Water intend to collaborate with the EA and take a similar GIS based approach to assessing Natural Flood Management options where tackling shared surface water flooding issues.

Next Steps

A cornerstone of the DWMP framework and process is collaboration between water companies and key stakeholders. To be successful in developing an effective plan that provides innovative solutions and better value for customers, while protecting our environment and ensuring we meet the future pressure on our drainage systems, we need to work together, and we rely on the active participation of our stakeholders to engage with us in the concept, planning and delivery of this plan.

APPENDICES

APPENDIX A: SEWER OVERFLOW DETAILS

South West Water has a programme to monitor the use and performance of storm overflows and the number of monitors is planned to increase. The table below provides a summary of any available performance data for storm overflows in the catchment.

Table 28: Storm Overflow Performance Metrics

CD_Number	Waterbody	2019 Reportable	2019 Nr. Spills	2020 Reportable	2020 Nr. Spills	2021 Reportable	2021 Nr. Spills
CD201900	Looe and Fowey	Y	190	Y	247	Y	173
CD707020	Looe and Fowey	Y	194	Y	188	Y	156
CD707030	FOWEY	Y	169	Y	172	Y	138
CD514470	Looe and Fowey	Y	98	Y	154	Y	141
CD708860	Looe and Fowey	Y	130	Y	130	Y	115
CD713850	Looe and Fowey	Y	115	Y	125	Y	109
CD203870	Polperro River	N	n/a	Y	123	Y	122
CD500400	Looe and Fowey	Y	114	Y	115	Y	91
CD204680	Seaton	Y	90	Y	105	Y	90
CD720560	Pont Pill	Y	87	Y	97	Y	65
CD203220	Seaton	Y	82	Y	93	Y	59
CD707300	n/a	Y	81	Y	86	Y	84
CD718360	Looe and Fowey	Y	47	Y	81	Y	58
CD203010	East Looe River	Y	95	Y	80	Y	90
CD709600	Looe and Fowey	Y	58	Y	79	Y	67

CD_Number	Waterbody	2019 Reportable	2019 Nr. Spills	2020 Reportable	2020 Nr. Spills	2021 Reportable	2021 Nr. Spills
CD709610	Looe and Fowey	Y	74	Y	75	Y	65
CD721260	Looe and Fowey	Y	115	Y	70	Y	158
CD406610	Looe and Fowey	Y	0	Y	49	Y	47
CD405620	Seaton	N	n/a	Y	39	Y	37
CD707250	Looe and Fowey	Y	17	Y	23	Y	25
CD401760	Fowey (Warleggan to St Neot)	N	n/a	Y	16	Y	25
CD713830	East Looe River	Y	19	Y	15	Y	0
CD513430	Looe and Fowey	Y	1	Y	12	Y	10
CD513810	East Looe River	Y	17	Y	11	Y	27
CD513880	Seaton	Y	4	Y	7	Y	9
CD508780	Looe and Fowey	Y	0	Y	6	Y	0
CD718940	Seaton	Y	2	Y	6	Y	0
CD707050	FOWEY	Y	7	Y	4	Y	0
CD707040	Looe and Fowey	Y	0	Y	3	Y	2
CD513440	Looe and Fowey	Y	0	Y	2	Y	0
CD513870	Seaton	Y	0	Y	0	Y	0

APPENDIX B: STORM OVERFLOW ASSESSMENT FRAMEWORK (SOAF) DETAILS

Storm overflows which do not affect Bathing Waters or Shellfish Waters, but may impact on amenity watercourses, are managed in accordance with the Storm Overflow Assessment Framework (SOAF) industry guidance. The following table shows the SOAF information for each storm overflow in the catchment

Table 29: SOAF triggered investigation sites

Site Name	CD Number
BONE MILL SPS_PSCSOEO_LOOE	CD713850
BULLER QUAY_CS0_LOOE	CD500400
FOWEY STW_SSO_FOWEY	CD201900
HANNAFORE SPS_PSCSOEO_LOOE	CD709610
LANREATH SPS_PSCSOEO_LANREATH	CD720560
LERRYN CAR PARK SPS_PSCSOEO_LOSTWITHIEL	CD718360
LODGEHILL STW_SSO_LISKEARD	CD203010
MENHENIOT STW_SSO_MENHENIOT	CD203220
PELYNT STW_SSO_PELYNT	CD203870
PLAIDY SPS_PSCSO_LOOE	CD709600
POLPERRO FINESCREEN STW_CS0_POLPERRO	CD406610
ST CLEER STW_SSO_LISKEARD	CD204680
WEST LOOE QUAY_CS0_LOOE	CD514470

APPENDIX C: RESPONSIVE INVESTMENT OPTIMISATION

Reactive investment needs are identified via investigations following reactive response to operational/customer issues and planned surveys that are targeted to detect and resolve problems before they have an impact on customers and the environment.

The investment needs are prioritised based on the risk to properties and the identification of repeat events. These needs then form a programme of works for delivery over the next 12 months. Details for any needs recorded for the Fowey-Looe-Seaton catchment are also shown in Table below.

Table 30: Reactive investment opportunities

IM Number	Driver	Route	Stage	Status	Stage No
N91924	Capital Maintenance	Rapid Investment - WWS-Networks (Pollution)	Contractor Scoping	In Progress	Stage 3
N91922	Quality	Rapid Investment - WWS-Networks (Flooding)	Review Scope	In Progress	Stage 6
N91917	Quality	Rapid Investment - WWS-Networks (Flooding)	Review Scope	In Progress	Stage 6
N91329	Capital Maintenance	Rapid Investment - WWS-Networks (Flooding)	Review Scope	In Progress	Stage 6
N87020	Quality	Rapid Investment - WWS-Networks (Flooding)	Confirm Scope	In Progress	Stage 7
N70366	Capital Maintenance	Rapid Investment - WWS-Networks (Flooding)	Confirm Scope	In Progress	Stage 7
N91219	Capital Maintenance	Rapid Investment - WWS-Networks (Pollution)	Confirm Scope	In Progress	Stage 7
N82466	Capital Maintenance	Rapid Investment - WWS-Networks (Flooding)	Confirm Scope	In Progress	Stage 7
N70356	Capital Maintenance	Rapid Investment - WWS-Networks (Flooding)	Confirm Scope	In Progress	Stage 7
N91325	Capital Maintenance	Rapid Investment - WWS-Networks (Flooding)	Confirm Scope	In Progress	Stage 7


IM Number	Driver	Route	Stage	Status	Stage No
N83168	Quality	Rapid Investment - WWS-Networks (Flooding)	Confirm Scope	In Progress	Stage 7
N79022	Capital Maintenance	Rapid Investment - WWS-Networks (Flooding)	Confirm Scope	In Progress	Stage 7
N71418	Capital Maintenance	Rapid Investment - WWS-Networks (Transferred Sewers)	Confirm Scope	In Progress	Stage 7
N82524	Quality	Rapid Investment - WWS-Networks (Flooding)	Confirm Scope	In Progress	Stage 7
N68717	Capital Maintenance	Rapid Investment - WWS-Networks (Transferred Sewers)	Completed	Completed	Stage 9

APPENDIX D: SURFACE WATER SEPARATION AND SuDS APPROACH


To explore opportunities for SWS and SuDS, Stantec's GIS based Surface Water Assessment Tool (SWAT) was applied to the 26 Complex TPUs that were hydraulically modelled for future flood risk (FFR). The tool plots impermeable areas, green space, existing networks, buildings, roads and watercourses. It plots existing foul combined and surface water networks and identifies where surface water sewers join combined sewers as potential points for disconnection. It identifies potential land and road space as well as residential and commercial properties for different interventions.

Using this insight our approach for surface water separation and SuDS is to find an alternative pathway for surface water, where we identify surface water contributing to risks in our networks. Surface water can originate from buildings, roads/highways and paved areas. Surface water collection may also exist but be connected to the foul network at some point. In this case we would consider options to provide an alternative pathway for the surface water such a swale or other watercourse or SuDS solution where space and natural topography support this approach. This would include conveying the surface water to an appropriate location. Further modelling and investigations are required to ensure this will not generate a surface water flooding risk elsewhere.


SWAT Tool outputs

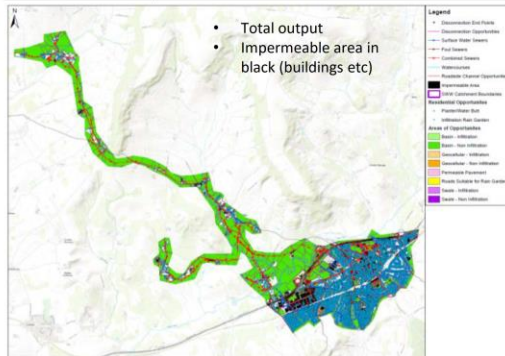


Foul, Combined, SW sewers

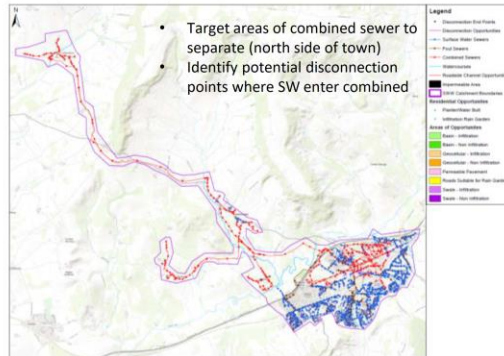


Areas of SUDS opportunity

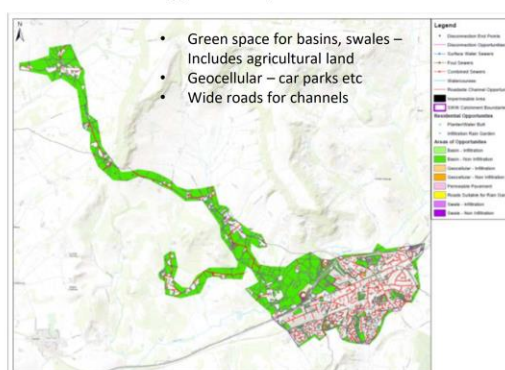

Open space SUDS opportunity

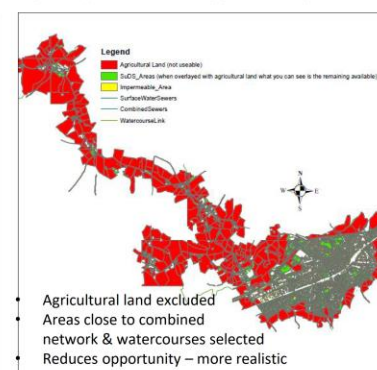

Residential SUDS opportunity

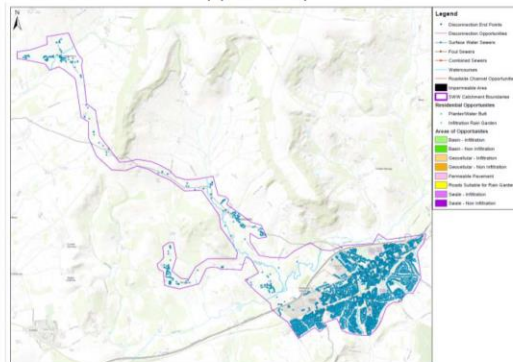

Summary

SWAT and GIS Assessment

- Green space assessed for the 26 complex catchments modelled for Future Flood risk
- All recommended surface water separation
- Agricultural land removed, considered unavailable
- Areas close to combined network & watercourses selected and compared to SWS needed

Results

- SUDS suitable for an average 55% of the SWS needed for FFR
- Ranges from 0% in some TPUs (no infiltration option, no watercourses) to 100% in others
- NB This **excludes** residential opportunities – could still look at rain gardens on roofs, schools etc, pavement, tree pits, water butts etc

Figure 17: Approach to assessing opportunity for SuDS solutions for Surface Water Separation

APPENDIX E: CURRENT AND PLANNED UPSTREAM THINKING (UST) PROJECTS

South West Water’s infiltration and site surveys may identify opportunities for Natural Flood Management and Upstream Thinking interventions in the Fowey-Looe-Seaton catchment. South West Water intend to collaborate with the EA and take a similar GIS based approach to assessing Natural Flood Management options where tackling shared surface water flooding issues. The figure below shows the coverage of current upstream thinking (UST) projects in the vicinity of the Fowey-Looe-Seaton catchment where upper catchment solutions are being explored; the intention is to expand this approach.

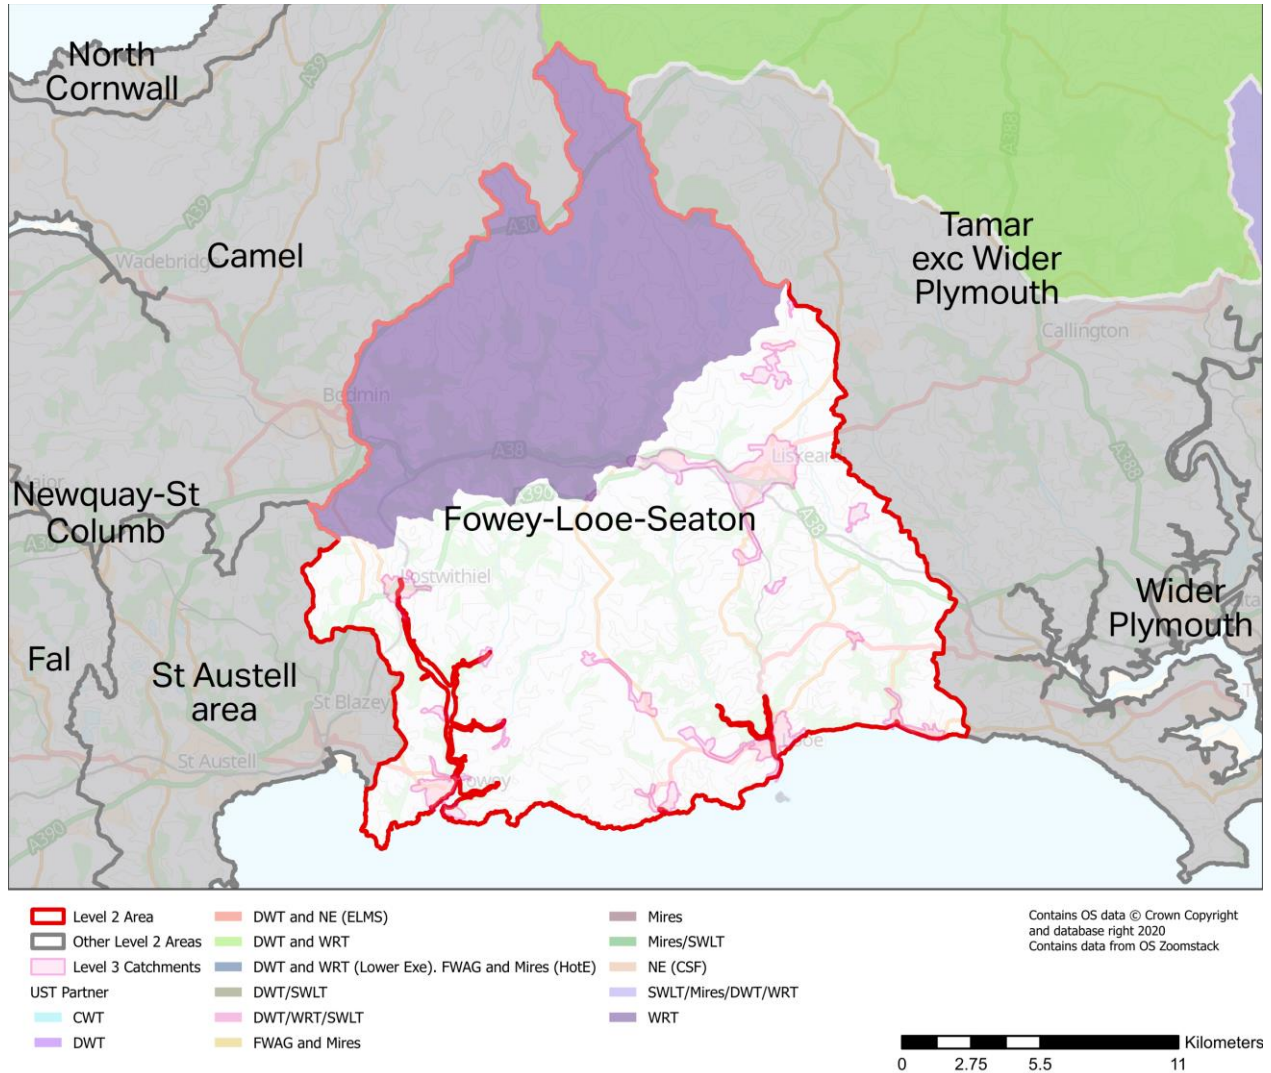


Figure 18: Catchments with Upstream Thinking Programmes